

MFPA Leipzig GmbH

Testing, inspection and certification body for
building materials, building products and building systems

Division III - Structural Fire Protection

Dipl.-Ing. Sebastian Hauswaldt

**Team 3.2 - Fire Behaviour of Building Types and
Special Structures**

Dipl.-Ing. S. Bauer

Phone +49 (0) 341-6582-194

s.bauer@mfpaleipzig.de

Test report no. PB 3.2/19-244-1

25 July 2019

1st copy

Subject matter: Orienting fire test of loaded type "KP" cable clamps in accordance with
DIN EN 1363-1:2012-10 under thermal stress according to the standard
time-temperature curve (ETK) to determine the fire resistance period.

Client: Sormat Oy
Harjutie 5
FI-21290 Rusko
Finland

Date of order: 4 March 2019

Date of testing: 4 July 2019

Identification: KP in corresponding size

Person in charge: Dipl.-Ing. S. Bauer

This report consists of 4 pages and 4 enclosures.

This document may only be copied in an unabridged form. Any publication – including extracts – requires the prior written approval of MFPA Leipzig GmbH. The German document with original signatures and the original seal of the authorized signatory is the legally binding version. The terms and conditions (T&C) of MFPA Leipzig GmbH apply.

Gesellschaft für Materialforschung und Prüfungsanstalt für das
Bauwesen Leipzig mbH (MFPA Leipzig GmbH)

Registered office: Hans-Weigel-Str. 2b – 04319 Leipzig/Germany

Managing Director: Dr.-Ing. habil. Jörg Schmidt

Company Register: District Court Leipzig HRB 17719

VAT ID No.: DE 813200649

Phone: +49 (0) 341-6582-0

Fax: +49 (0) 341-6582-135

1 Reason and objective

On 4 March 2019, Sormat Oy commissioned MFPA Leipzig GmbH to perform an orienting fire test of mechanically loaded cable clamps type "KP" in accordance with DIN EN 1363-1:2012-10 [1] under thermal stress according to the standard time-temperature curve (TTC) to verify a fire resistance period of 90 minutes.

This test report describes the structural set-up, the test conditions and the results of the fire test from 4 March 2019.

The tests were performed at the Fire Test Centre of MFPA Leipzig GmbH, MFPA-Allee 1, 04209 Laue bei Delitzsch, Germany.

2 Description of the tested constructions

The type "KP" cable clamp is used to clamp cables, hoses and other elongated elements. It consists of a basic body, which can be hung up, and a screwable clamp and is designed for use in the cable ladder KS80-300 L of the company Meka, see figure 1. Cable clamp and cable ladder are made of galvanized steel (clamp 25 μm , ladder 55 μm). The diameter of the cable clamps varies from 12 mm to 82 mm. The number in the name of the individual cable clamp sizes indicates the maximum permissible cable cross-section which can be mounted using this cable clamp.

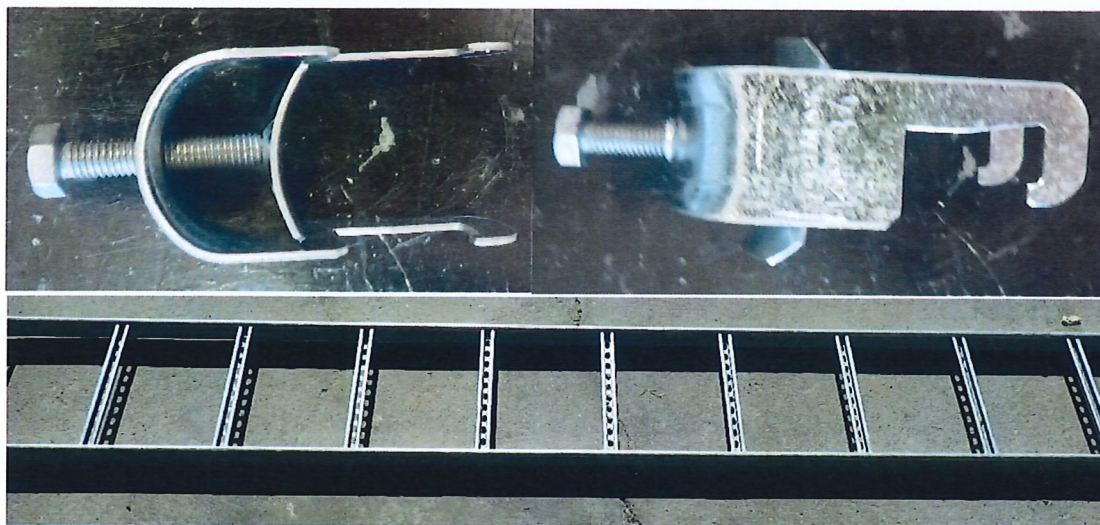



Figure 1 View of the KP 34 cable clamp and the cable ladder KS80-300 L

All sizes, from KP 12 to KP 82, were tested while attached to cable ladders KS80-300 L and loaded with a maximum central load which was defined by the client. For details and photos of the clamps, please refer to enclosures 1 and 4.

3 Set-up and performance of the test

The reinforced concrete ceiling section to which the cable ladders were attached using concrete drilling screws formed the upper horizontal space enclosure of the fire chamber during the fire test. After 28 days, the concrete section could be assigned to compressive strength class C 20/25. The positions of the samples in the test furnace are shown in enclosure 2.

The cable clamps were loaded by suspending dead loads. The clamps were subjected to central tension and thermal load from all sides. In this way, the fire resistance period was determined. The fire tests were performed in accordance with DIN EN 1363-1:2012-10 [1], using the standard temperature-time curve (TTC).



To verify the temperatures in the fire area, five plate thermometers in accordance with DIN EN 1363-1:2012-10 [1], section 4.5.1.1, were installed in the fire chamber at a distance of 150 mm to the reinforced concrete ceiling to control the fire area temperature. All fire area temperatures were measured and recorded at intervals of 5 seconds. The temperatures which were measured in the fire chamber during the fire test are graphically analysed in enclosure 3.

4 Test results and analysis

The results of the orienting fire test are listed in table 1 below including the cause of failure. The test duration was 93 minutes.

Table 1 Results of the orienting test of the loaded cable clamps

Number	Size	Suspended load [kg]	Time of failure [min:s]	Cause of failure
1.1	KP 12	1.0	93:00	No failure during the test
1.2	KP 12	1.0	93:00	No failure during the test
1.3	KP 14	1.0	93:00	No failure during the test
1.4	KP 14	1.0	93:00	No failure during the test
1.5	KP 18	1.0	93:00	No failure during the test
1.6	KP 18	1.0	93:00	No failure during the test
1.7	KP 22	1.0	93:00	No failure during the test
1.8	KP 22	1.0	93:00	No failure during the test
2.1	KP 26	2.0	93:00	No failure during the test
2.2	KP 26	2.0	93:00	No failure during the test
2.3	KP 30	2.0	93:00	No failure during the test
2.4	KP 30	2.0	93:00	No failure during the test
2.5	KP 34	3.0	93:00	No failure during the test
2.6	KP 34	3.0	93:00	No failure during the test
2.7	KP 40	3.0	93:00	No failure during the test
2.8	KP 40	3.0	93:00	No failure during the test
3.1	KP 46	3.0	93:00	No failure during the test
3.2	KP 46	3.0	93:00	No failure during the test
3.3	KP 52	3.0	93:00	No failure during the test
3.4	KP 52	3.0	93:00	No failure during the test
3.5	KP 60	3.0	93:00	No failure during the test
3.6	KP 60	3.0	93:00	No failure during the test
3.7	KP 82	3.0	93:00	No failure during the test
3.8	KP 82	3.0	93:00	No failure during the test



The orienting fire test showed that the cable clamps with the relevant corresponding central loads, see table 1, did not fail under the influence of thermal stress according to the standard time-temperature curve (TTC). This means that the type "KP" cable clamps with the sizes and loads which are shown in table 2 have a fire resistance period above 90 minutes.

Table 2 Fire resistance period with corresponding central load

Type	central load	Fire resistance period
KP 12	1 kg	90 minutes
KP 14	1 kg	
KP 18	1 kg	
KP 22	1 kg	
KP 26	1 kg	
KP 30	2 kg	
KP 34	2 kg	
KP 40	3 kg	
KP 46	3 kg	
KP 52	3 kg	
KP 60	3 kg	
KP 82	3 kg	

The results of the tests refer exclusively to the test items described herein. This document does not replace any certificate of conformity or usability as defined by the building regulations (national/European).

Leipzig, 25 July 2019

Dr.-Ing. habil. J. Schmidt

Managing Director



Dipl.-Ing. S. Bauer

Test Engineer

Enclosures

- Enclosure 1 Parameters of the type "KP" cable clamp and the cable ladder KS80-300 L
- Enclosure 2 Structural design of the testing device and installation situation
- Enclosure 3 Measured values
- Enclosure 4 Photo documentation of the fire test

Corresponding documents

- [1] DIN EN 1363-1:2012-10 Fire resistance tests - Part 1: General Requirements

Enclosure 1 Parameters of the type "KP" cable clamp and the cable ladder KS80-300 L

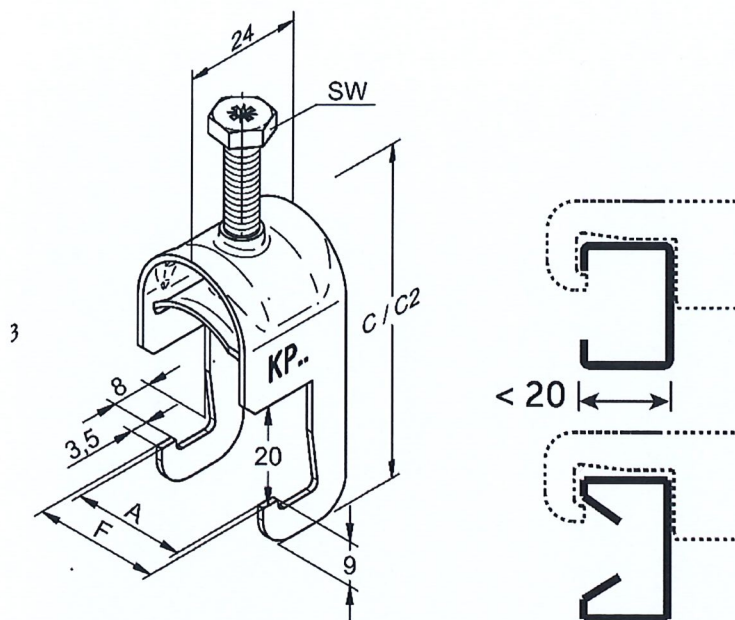



Figure A1.1 Detailed drawing of the cable clamp with examples of suitable profiles

Table A1.2 Parameters of the cable clamp

KP	A	F _{max}	C
12	14	18	48
14	15	19	48
18	19	23	51
22	23	27	55
26	27	31	58
30	31	35	65
34	35	39	68
40	41	45	75
46	47	51	81
52	53	57	90
60	62	66	97
82	83	87	128





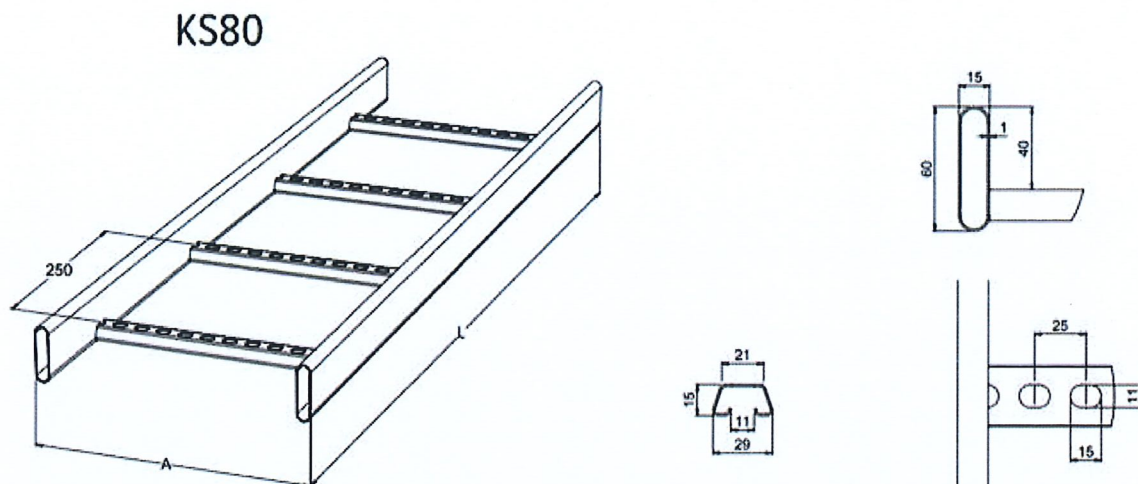


Figure A1.3 Detailed drawing of the cable ladder

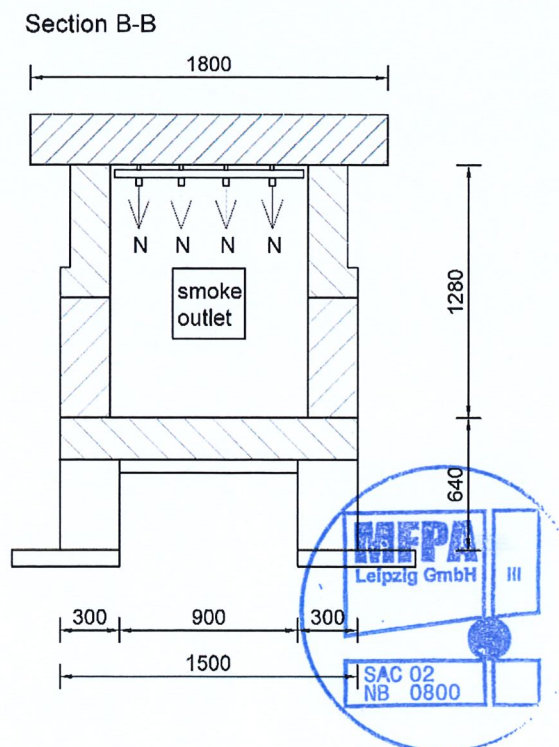

Enclosure 2 Structural design of the testing device and installation situation

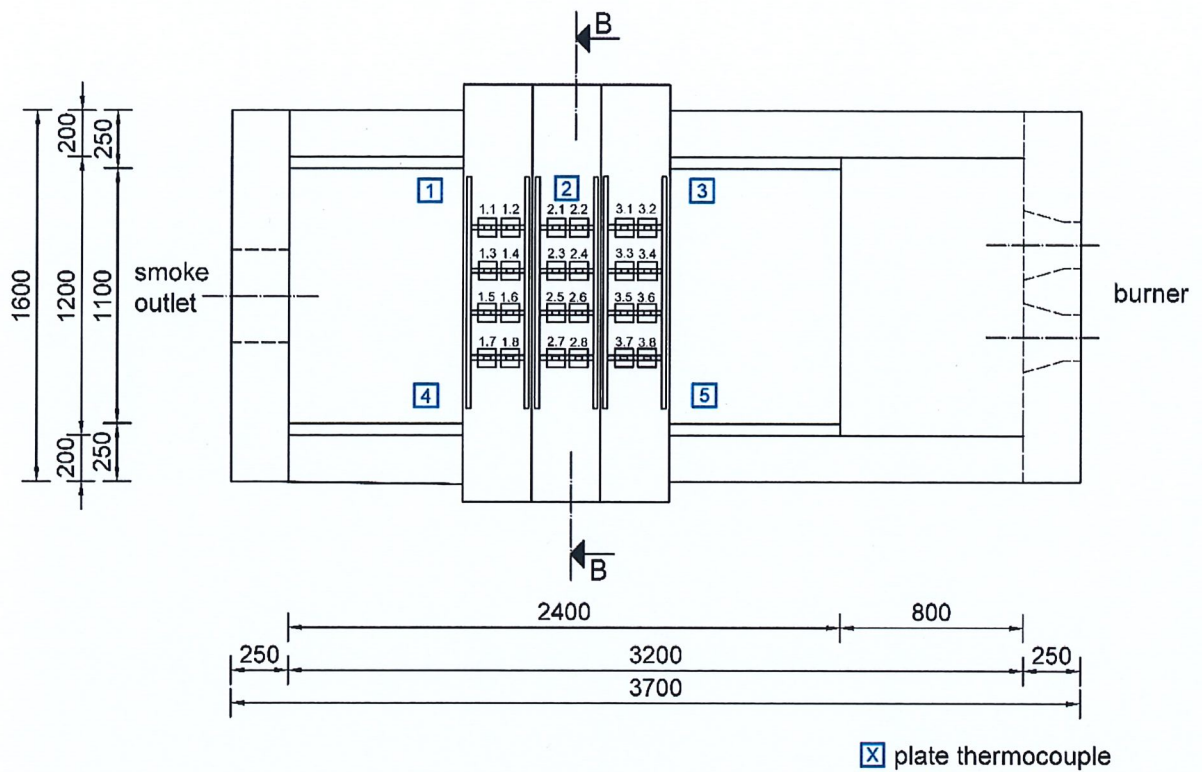

Enclosure 3 Measured values

Diagram A3.1 Temperatures in the fire area

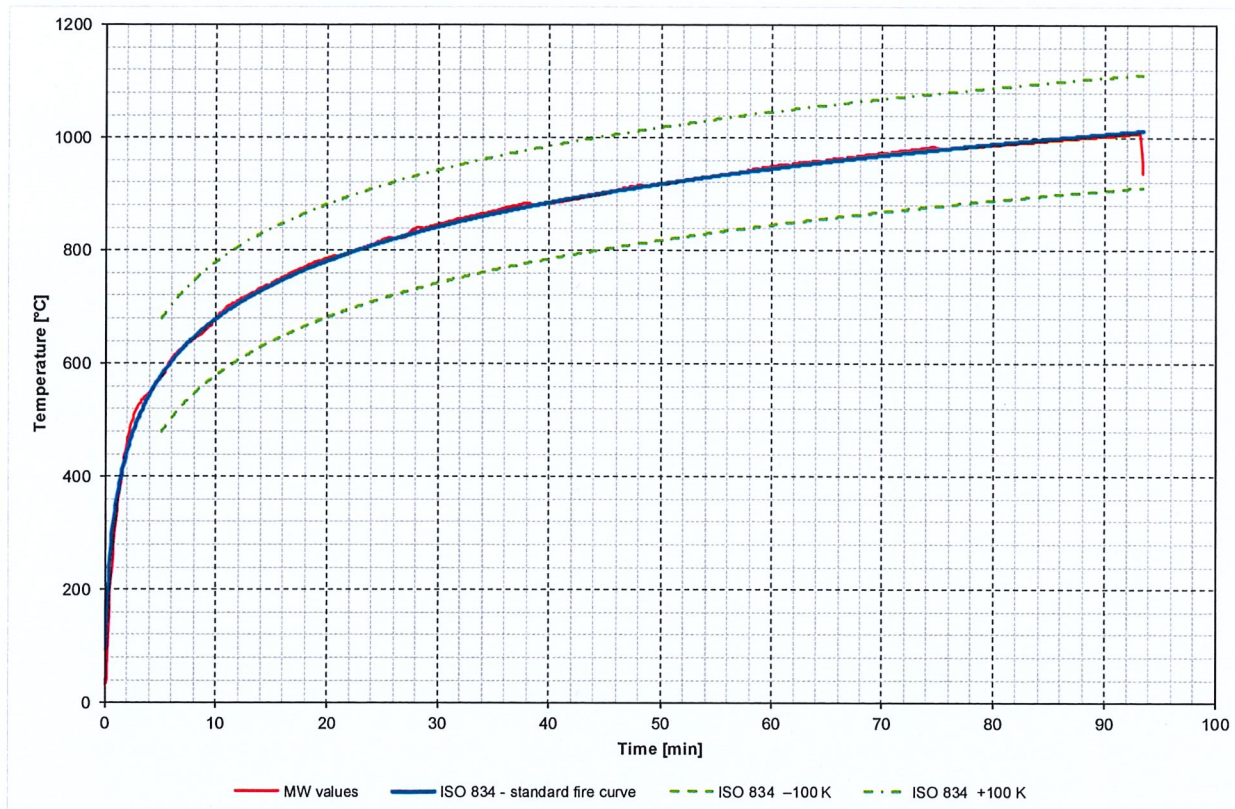


Diagram A3.2 Deviation from the integral of the standard temperature-time curve (TTC)


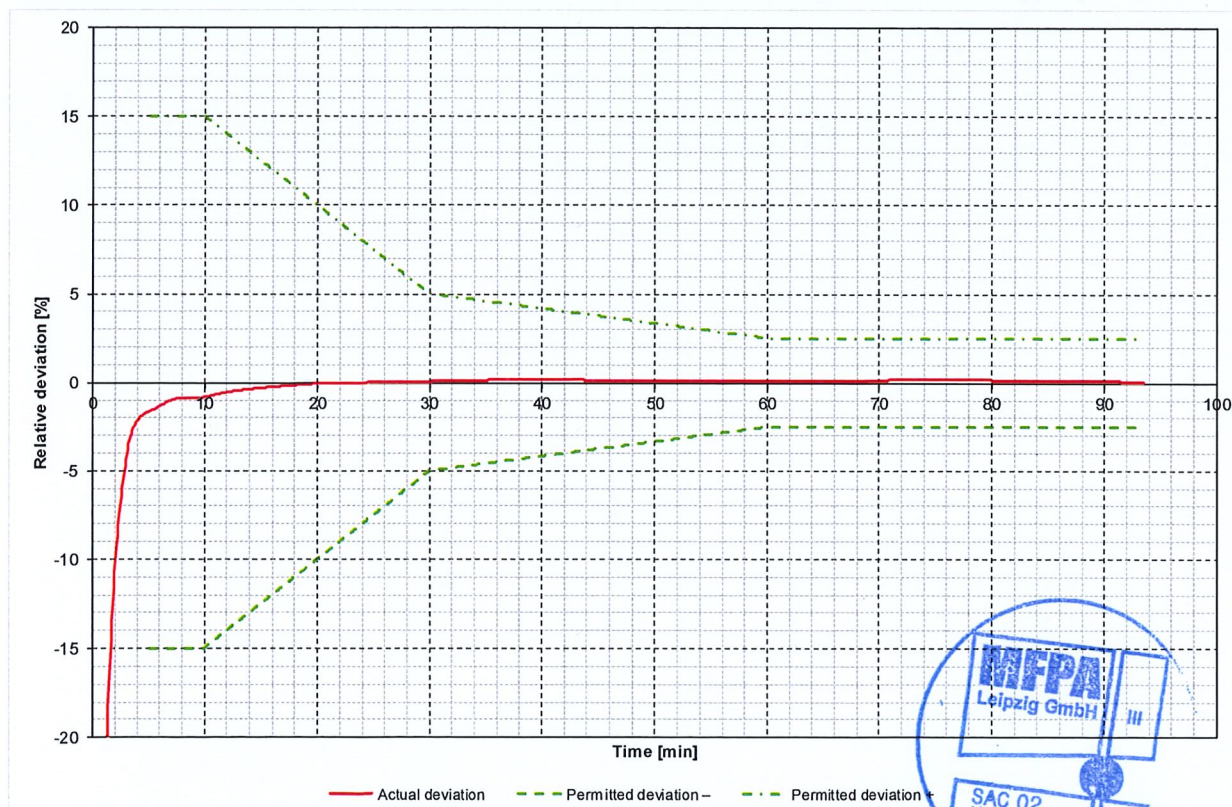




Diagram A3.3 Pressure in fire area

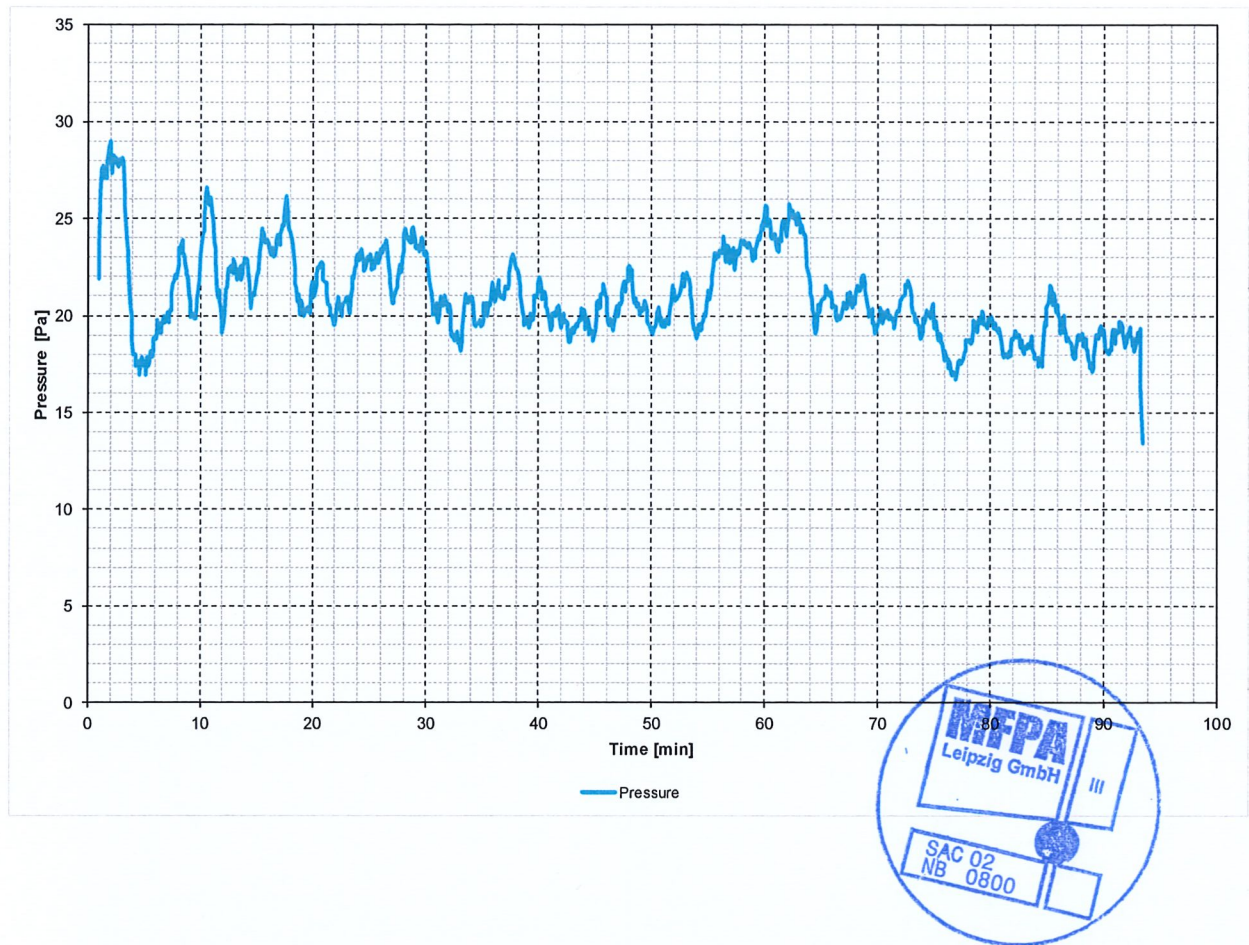

Enclosure 4 Photo documentation of the fire test

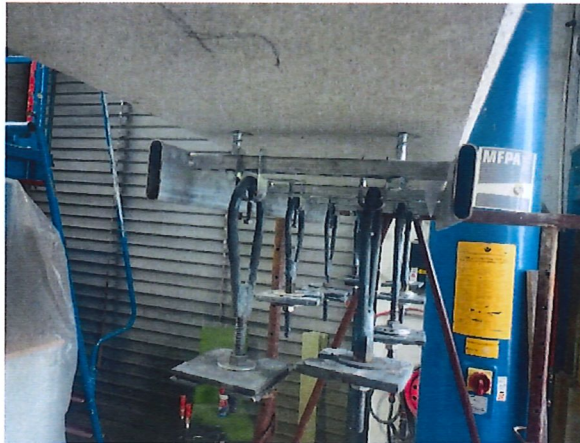


Figure A4.1 View of the test set-up.



Figure A4.2 View of the test set-up.

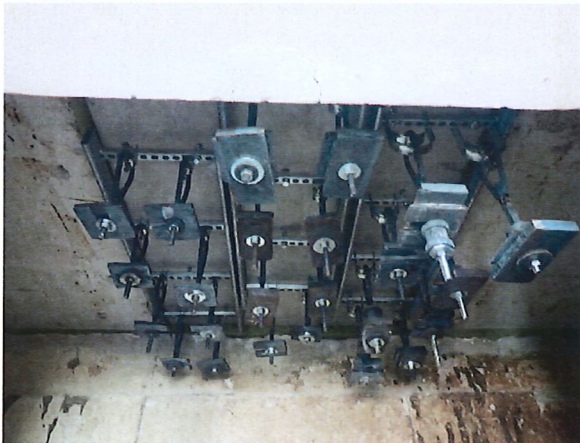


Figure A4.3 View of the clamps in the test furnace.



Figure A4.4 View of the clamps in the test furnace.

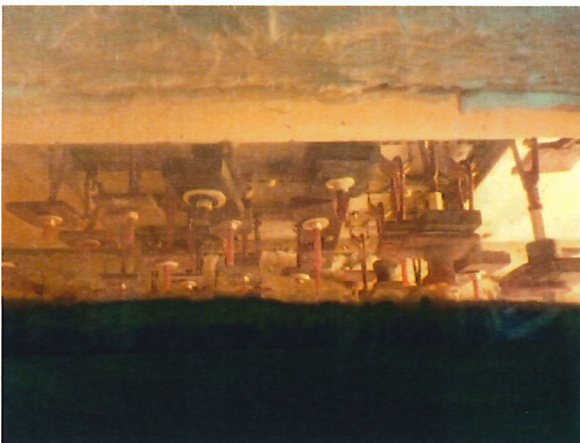


Figure A4.5 View of the clamps in the 20th minute of test.

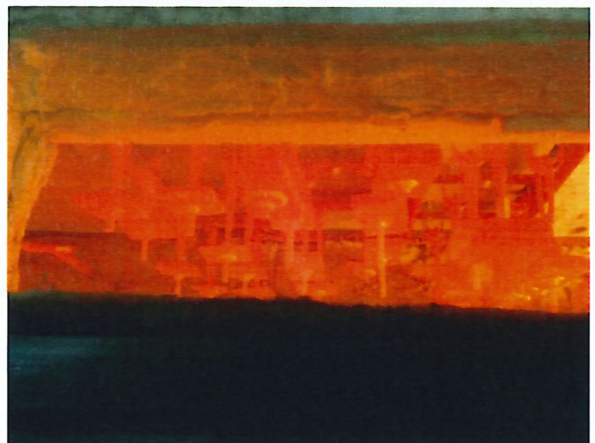


Figure A4.6 View of the clamps in the 45th minute of test.



Figure A4.7 View of the clamps in the 60th minute of test.

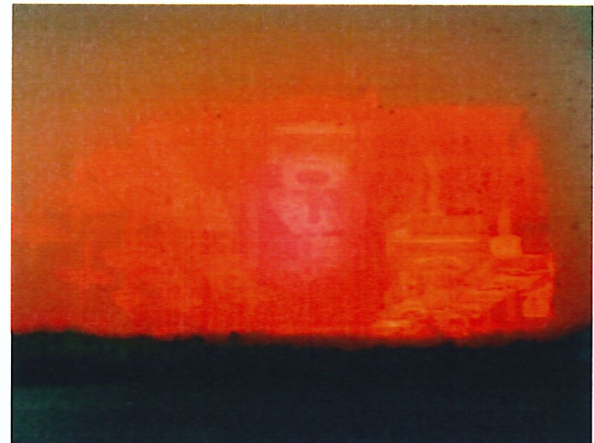


Figure A4.8 View of the clamps in the 90th minute of test.

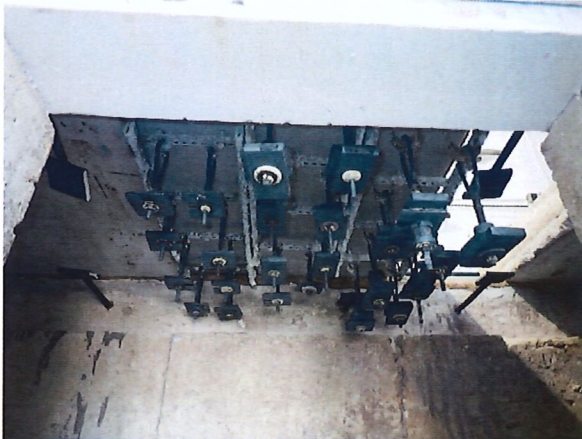


Figure A4.9 View of the clamps in the test furnace after the fire test.



Figure A4.10 View of the test set-up after the fire test.

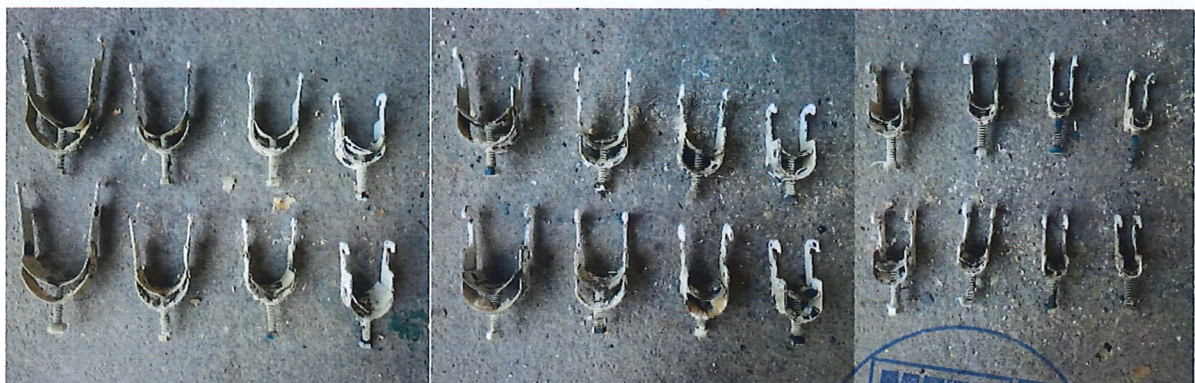


Figure A4.11 View of the clamps after the fire test.

