


ABB MEASUREMENT & ANALYTICS | DATA SHEET

PxS100, PxF100, PxD100

Gauge and absolute pressure transmitters

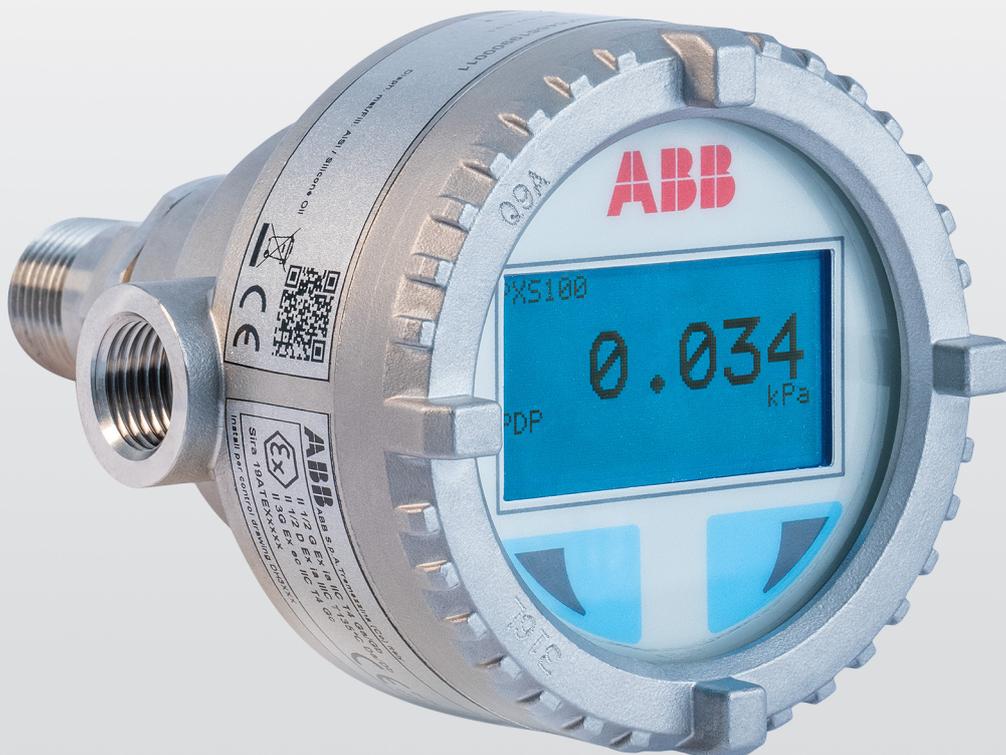

Measurement made easy

Engineered solutions for all applications

Standard overload resistance

Base accuracy

- upto ± 0.075 % of calibrated span

Span limits

- 0,3 – 10000 kPa; 16 inH₂O up to 1450 psi
- 0,3 – 10000 kPa abs; 30 mmHg up to 1450 psia

Proven sensor technology together with state-of-the-art digital technology

- Valuable turn down ratio of up to 100:1

Stainless steel housing

- Optimized for use in industrial process environments
- Extremely robust

New touch keypad technology

- allows quick and easy local configuration without opening the cover, even in hazardous classified locations
- backlit display

Flexible configuration options

- Local configuration via setup button for upper and lower range values
- Local configuration via buttons on HMI
- Via handheld terminal or PC user interface

PED compliance

- Category III for PS > 20 MPa, 200 bar
- Sound Engineering Practice (SEP) for PS \leq 20 MPa, 200 bar

Product in compliance with Directive 2011/65/UE (RoHS II)

Digital Advanced Diagnostics feature

Specification - Physical*

Materials

Process isolating diaphragms (**)

AISI 316 L ss, Hastelloy C276,
Diaflex (antiabrasion), H-Shield (against hydrogen permeation)

Process connection (**)

AISI 316 L ss

Filling fluids

Silicone oil, inert fill (fluorocarbon), Mineral oil (FDA approved), Vegetal oil (FDA approved)
Refer to S26 datasheet for additional information on other available filling fluids

Mounting bracket

AISI 304 ss

Sensor housing, electronics housing and cover

AISI 316 L ss

Filter for atmospheric ventilation

- Filter material: polyamide (PA)
- Filter housing: plastic (general purpose version), stainless steel (Ex certified versions)

Viewing window of display cover

Glass

Cover O-ring

EPDM for sensor O-ring and cover O-ring to glass;
EPDM for cover O-ring to housing
Silicon for cover O-ring to housing

Process connection O-ring

EPDM for front bonded connection on Pxs100
EPDM, FKM or HNBR for universal connection on PxF100

Plates

Nameplate, certification (if applicable) and tag (if requested) labels self-adhesive attached to the electronics housing.

Calibration

- Standard: 0 to upper range limit (URL)
- Optional: to specified measuring span

Optional extras

Mounting bracket (code BU)

Universal for vertical and horizontal 60 mm (2 in) pipes or wall mounting

Display (code Dx)

Can be rotated in 5° increments into 72 positions
(suggested ± 180° clockwise/anticlockwise rotation)

Additional plate

Self-adhesive label for tag and/or calibration details (up to 20 characters). Only by ordering option **code SC** for tag purposes, tag value will both be transferred in the memory of the instrument itself and appear on the optional certificates. Please be aware that display will only show last 8 digits of tag number.

AISI 316 ss wired-on plate with laser printed customized data (4 lines of 32 characters 4 mm/0.16 in high). By ordering option **code LEW**, custom text has to be provided. In case of no text provided, wired-on plate will be delivered blank.

Be aware that if tag is only indicated as part of the custom text, it will neither be transferred in the memory of the instrument itself nor appear on the relevant certificate. If that is required, please order option code SC.

Cleaning procedure for oxygen service (code P1)

Certificates (test, design, characteristics, material traceability) (code Cx)

Approvals (code Gx)

Operating instruction language (code Mx)

Electrical connections

M16 x 1.5 threaded entry on housing.
M20 x 1.5 or 1/2 in - 14 NPT threaded adapters available on request (supplied loose).

Terminals

Two screw connections for signal / auxiliary power supply, for wire cross-sections from 0.5 – 1.5 mm² (16 AWG)

Grounding

Both internal and external ground terminals for wire cross-sections up to 4 mm² (12 AWG).

Weight

- Approx. 950-2500g (2.1-5.5lb)
- For Pxs100 additional 200 g (0.44 lb) for packaging
- For PxF100 and Pxs100 with M26 additional 400 g (0.88 lb) for packaging
- For PxD100 weight might vary depending on the selected S26 model

Packaging

- Carton with dimensions of approx. 180 x 160 x 130 mm (7.1 x 6.3 x 5.1 in) (Pxs100 models)
- Carton with dimensions of approx. 270 x 235 x 185 mm (10.6 x 9.25 x 7.3 in) (For PxF100 and Pxs100 with M26)
- For PxD100 carton dimension might vary depending on the selected S26 model

(*) Please refer to the ordering information to check the availability of different versions of the relevant model

(**)Wetted parts of the transmitter.

Functional – specification

Range and span limits

| Sensor code | Upper range limit (URL) | Lower range limit (LRL) | Minimum measuring span | |
|-------------|-------------------------|-------------------------|-----------------------------|--------------------------------|
| | | | Model PGx100 Gauge pressure | Model PAX100 Absolute pressure |
| C | 6 kPa | -6 kPa | 0.3 kPa | 0.3 kPa |
| | 60 mbar | -60 mbar | 3 mbar | 3 mbar |
| | 24 inH2O | -24 inH2O | 1.2 inH2O | 2.25 mmHg |
| F | 40 kPa | -40 kPa | 2 kPa | 2 kPa |
| | 400 mbar | -400 mbar | 20 mbar | 20 mbar |
| | 160 inH2O | -160 inH2O | 8 inH2O | 15 mmHg |
| L | 250 kPa | -100 kPa | 12.5 kPa | 12.5 kPa |
| | 2500 mbar | -1 bar | 125 mbar | 125 mbar |
| | 1000 inH2O | -14.5 psi | 50 inH2O | 93.3 mm Hg |
| D | 1000 kPa | -100 kPa | 50 kPa | 50 kPa |
| | 10 bar | -1 bar | 0.5 bar | 0.5 bar |
| | 145 psi | -14.5 psi | 7.25 psi | 375 mmHg |
| K | 4000 kPa | -100 kPa | 200 kPa | 200 kPa |
| | 40 bar | -1 bar | 2 bar | 2 bar |
| | 580 psi | -14.5 psi | 29 psi | 29 psi |
| R | 10000 kPa | -100 kPa | 500 kPa | 500 kPa |
| | 100 bar | -1 bar | 5 bar | 5 bar |
| | 1450 psi | -14.5 psi | 72.5 psi | 72.5 psi |

IMPORTANT (NOTE)

The lower range limits (LRL) for models PAX100 are 0 absolute for all measuring ranges.

Span limits

Maximum span = upper range limit (URL)

To optimize performance characteristics, it is recommended that you select the transmitter sensor code providing the lowest turn down ratio.

TURNDOWN = Upper range limit / set span

Zero suppression and elevation

Zero and span can be adjusted to any value within the range limits detailed in the table as long as:

– calibrated span \geq minimum span

Damping

Configurable time constant between 0 and 60 s.

This is in addition to the sensor response time, and can be adjusted via the optional display, handheld terminal, or PC user interface.

Warm-up time

Ready for operation as per specifications in less than 10 s with minimum damping.

Insulation resistance

>100 M Ω at 500 V DC (between terminals and ground, according to EN61010-1 and EN62828-1 par 6.2.3.2).

Specification – Operative limits

Pressure limits

Overpressure limits

Without damage to the transmitter

No damage will occur during transmitter operation, if they are used within the specifications and subject to the following limits:

| Sensor code | Overpressure limits, 0 abs to: |
|-------------|--------------------------------|
| C , F | 1 MPa, 10 bar, 145 psi |
| L | 3 MPa, 30 bar, 435 psi |
| D | 6 MPa, 60 bar, 870 psi |
| K | 8 MPa, 80 bar, 1160 psi |
| R | 20 MPa, 200 bar, 2900 psi |

The below table shows the maximum pressure limits of the connection when coupled with customer process interface. The table also shows the compatibility of the sensor ranges.

| Model PxF100 Sensors | Seal type | Pressure limit |
|----------------------|--|------------------------|
| Sensors L to R | Universal G1" hygienic - AISI | 6MPa, 60bar, 870psi |
| | Universal G1" hygienic - HC | |
| | Universal G1" hygienic - Diaflex on AISI | |
| | Universal G1" hygienic - Diaflex on HC | |
| | Tri-Clamp (1½") | |
| All Sensors | Tri-Clamp (1") | 4MPa, 40bar, 580psi |
| | Tri-Clamp (2") | 3.8 MPa, 38bar, 550psi |
| | Tri-Clamp (3") | 2.4MPa, 24bar, 350psi |
| | Tri-Clamp (4") | 1.7MPa, 17bar, 250psi |
| | DRD 65mm | 4MPa, 40bar, 580psi |
| Diary 11851 DN40 | | |
| Sensors L to R | Diary 11851 DN50 | 2.5MPa, 25bar, 360psi |
| | SMS 1 ½" | 4MPa, 40bar, 580psi |
| | SMS 2" | |
| All Sensors | Variline® F DN25 | 2.5MPa, 25bar, 360psi |
| | Variline® N DN40 | |
| | Neumo Biocontrol® GR50 | 1.6MPa, 16bar, 230psi |
| | Neumo Biocontrol® GR65 | |
| Sensors L to R | Dairy DIN 11864-1 typeA DN40 | 4MPa, 40bar, 580psi |
| | Dairy DIN 11864-1 typeA DN50 | 2.5MPa, 25bar, 360psi |

Test pressure

When carrying out the transmitter pressure test, it is essential to observe the overpressure limits.

Temperature limits °C (°F)

Ambient

This is the operating temperature.

| Model PGx100, PAX100 | Ambient temperature limits |
|-----------------------------|--------------------------------|
| Operating temperature range | -40 and 85 °C (-40 and 185 °F) |
| LCD display readability | -20 and 70 °C (-4 and 158 °F) |

Process

| Model PGx100, PAX100 | Process temperature limits |
|------------------------------|----------------------------------|
| Process temperature range | -50 and 120 °C (-58 and 248 °F)* |
| EPDM gasket for front bonded | -45 and 140 °C (-49 and 284 °F)* |

* For PGD100, PAD100 please refer to process temperature limits driven by S26 remote seals

| Model PGF100, PAF100 | Process temperature limits |
|---|-----------------------------------|
| Process temperature range | -50 and 180 °C (-58 and 356 °F)** |
| EPDM gasket for universal connection | -50 and 150 °C (-58 and 302 °F) |
| FKM for gasket for universal connection | -20 and 200 °C (-4 and 392° F) |
| HNBR for gasket for universal connection) | -40 and 180 °C (-40 and 356° F) |

** Upper process temperature limit is valid considering an ambient temperature up to +50 °C (122 °F). In case of ambient temperature up to +85 °C (185 °F) upper process temperature limit is 150 °C (302 °F)

Upper and lower process temperature limits might vary according to the physical characteristics of the filling fluid and to the different gaskets which the customer decides to install.

Storage

| Model PGx100, PAX100 | Storage temperature limits |
|---------------------------|--------------------------------|
| Storage temperature range | -50 and 85 °C (-58 and 185 °F) |
| LCD display | -40 and 85 °C (-40 and 185 °F) |

| Model PGx100, PAX100 | Humidity during storage |
|----------------------|-------------------------|
| Relative humidity | Up to 75 % |

IMPORTANT (NOTE)

For Hazardous Atmosphere applications see the temperature range specified on the certificate/approval relevant to the aimed type of protection.

...Specification – Operative limits

Refer to the following FILL FLUID CHARACTERISTICS table detailing characteristics of fill fluids when used in transmitters and further limitation for specific models and/or variants.

PGF100 and PAF100

| Fill fluid (application) | Process temperature and pressure limits | | | | Specifications @ 25 °C (77°F) | | |
|--|---|----------------------------|---------------------------|-----------------|---------------------------------|---------------------------------|--|
| | Tmax °C (°F) @ Pabs > of | Pmin mbar abs (mmHg) | Tmax °C (°F) @ Pmin | Tmin °C (°F) | Specific gravity (kg/dm3) | Kinematic viscosity (cst) | Thermal expansion (x 10 ⁻³ /°C) |
| Silicone oil | 250 (480) @ 385 mbar | 0.7 (0.5) | 130 (266) | -40 (-40) | 0.934 | 10 | 1.08 |
| Inert oil (oxygen service) | 160 (320) @ 1 bar | 2.1 (1.52) | 60 (140) | -20 (-4) | 1.82 | 4.4 | 1.1 |
| Vegetable oil (food - sanitary) FDA approved | 200 (390) @ 1 bar | 10 (7.2) | 20 (68) | -18 (0) | 0.92 | 9.8 | 1.2 |
| Mineral oil (food - sanitary) FDA approved | 250 (480) @ 630 mbar | 0.7 (0.5) | 110 (230) | -6 (21) | 0.86 | 30 | 0.80 |

PGS100 and PAS100

| Fill fluid (application) | Process temperature and pressure limits | | | | Specifications @ 25 °C (77°F) | | |
|--|---|----------------------------|---------------------------|-----------------|---------------------------------|---------------------------------|--|
| | Tmax °C (°F) @ Pabs > of | Pmin mbar abs (mmHg) | Tmax °C (°F) @ Pmin | Tmin °C (°F) | Specific gravity (kg/dm3) | Kinematic viscosity (cst) | Thermal expansion (x 10 ⁻³ /°C) |
| Silicone oil | 250 (480) @ 900 mbar | 0.7 (0.5) | 45 (113) | -85 (-121) | 0.923 | 5 | 0.98 |
| Inert oil (oxygen service) | 160 (320) @ 1 bar | 2.1 (1.52) | 60 (140) | -20 (-4) | 1.82 | 4.4 | 1.1 |
| Mineral oil (food - sanitary) FDA approved | 200 (390) @ 200mbar | 33 (0.5) | 40 (104) | -6 (21,2) | 0,84 | 26 | 1.04 |

Absolute viscosity (cP) = Kinematic Viscosity (cSt) x Specific gravity at specified temperature.

The absolute viscosity value is used for response time calculation.

Seal system selection criteria

The following table shows the types of seals available as direct mount and remote.

According to the combination SEAL/TRANSMITTER SENSOR the table details the compatibility for one direct mount seal construction and the MAXIMUM CAPILLARY LENGTH when a seal is selected as remote.

The mnemonics will be used as shortest cross references in the S26 data sheet.

| Seal model | Seal type | "Seal diaphragm size (thickness) [flange type]" | Direct mount seal | | | | | | Remote seal | | | | | | Mnemonic |
|----------------------------------|--|---|-------------------|---|---|---|---|---|-------------|----|----|----|----|------|----------|
| | | | Sensor | | | | | | Sensor | | | | | | |
| | | | C | F | L | D | K | R | C | F | L | D | K | R | |
| S26WA S26WE | Wafer (ASME and EN standards) | 1.5 in / DN 40 | - | - | - | - | - | - | - | - | 3 | 5 | 5 | 5 | P1.5 |
| | | 2 in / DN 50 | - | - | - | - | - | - | - | 2 | 6 | 8 | 8 | 8 | P2 |
| | | 3 in / DN 80 | - | - | - | - | - | - | - | 4 | 10 | 10 | 10 | 10 | P3 |
| | | 1.5 in / DN 40 (low) | - | - | - | - | - | - | - | - | 3 | 6 | 6 | 6 | F1.5 |
| | | 2 in / DN 50 (low) | - | - | - | - | - | - | - | 3 | 8 | 6 | 16 | 16 | F2 |
| | | 3 in / DN 80 (low) | - | - | - | - | - | - | - | 6 | 10 | 12 | 16 | 16 | F3 |
| S26FA S26FE S26RA S26RE | Flanged flush diaphragm (ASME and EN standards) | DN 25 | - | - | Y | Y | Y | Y | - | - | - | - | - | - | F1.5 |
| | | DN 25 (recessed diaphragm) | - | - | Y | Y | Y | Y | - | - | - | - | - | - | T2 |
| | | 2 in / DN 50 | Y | Y | Y | Y | Y | Y | - | 2 | 6 | 8 | 8 | 8 | P2 |
| | | 3 in / DN 80 | Y | Y | Y | Y | Y | Y | - | 4 | 10 | 10 | 10 | 10 | P3 |
| | | 4 in / DN 100 | Y | Y | Y | Y | Y | Y | - | 4 | 10 | 10 | 10 | 10 | P3 |
| | | 2 in / DN 50 (low) | Y | Y | Y | Y | Y | Y | - | 3 | 8 | 12 | 16 | 16 | F2 |
| | Flanged extended diaphragm (ASME and EN standards) | 3 in / DN 80 (low) | Y | Y | Y | Y | Y | Y | - | 6 | 10 | 16 | 16 | 16 | F3 |
| | | 4 in / DN 100 (low) | Y | Y | Y | Y | Y | Y | - | 6 | 10 | 16 | 16 | 16 | F3 |
| | | 2 in / DN 50 | - | - | Y | Y | Y | Y | - | - | 4 | 6 | 6 | 6 | E2 |
| | | 3 in / DN 80 | Y | Y | Y | Y | Y | Y | - | 4 | 8 | 10 | 10 | 10 | E3 |
| | | 4 in / DN 100 | Y | Y | Y | Y | Y | Y | - | 4 | 10 | 10 | 10 | 10 | P3 |
| | | 2 in / DN 50 [fixed] | - | - | Y | Y | Y | Y | - | - | 3 | 6 | 6 | 6 | F1.5 |
| | 3 in / DN 80 [fixed] | Y | Y | Y | Y | Y | Y | - | 6 | 10 | 12 | 12 | 12 | F2.5 | |
| | 4 in / DN 100 [fixed] | Y | Y | Y | Y | Y | Y | - | 6 | 10 | 12 | 12 | 12 | F2.5 | |

...Specification – Operative limits

Environmental limits

Electromagnetic compatibility (EMC)

The devices comply with the requirements and tests for EMC Directive 2014/30/EU to standards EN 61326-1 Table 2 (industrial electromagnetic environment) concerning both emitted interference (CISPR11) and interference immunity.

- Burst test: up to 2 kV at 5 kHz and 100 kHz
- Surge test: up to 1 kV line-line and 2 kV line-ground

Radiated emission: Group 1 - class B according to CISPR11

- FCC 47 CFR part 18.305
- ICES 005 - Issue 4

Conducted emission: group 1 - class A according to CISPR11 and to CISPR32

- ICES 005 - Issue 4

Pressure equipment directive (PED)

Comply with 2014/68/EU to standards ANSI/ISA S82.03

- Category III Module H for PS > than 20 MPa, 200 bar
- Sound Engineering Practice (SEP) for PS ≤ 20 MPa, 200 bar.

Humidity

Relative humidity: up to 100 %

Condensation, icing: permissible

Vibration resistance

Acceleration at frequencies of

- 10 – 60 Hz with displacement of 0.7 mm
- 60 – 1000 Hz 5 g (50 m/s²)

(according to IEC 60068-2-6).

Shock resistance

Test Ea Half sine with 3 positive and 3 negative shocks for each axis

- Acceleration: 50 g
- Duration: 11 ms

Continuous test Ea half sine with 1000 positive and 1000 negative shocks for each axis

- Acceleration: 10 g
- Duration: 10 ms

(according to IEC 60068-2-27)

Wet and dust-laden atmospheres (IP degree of protection)

The transmitter is dust and sand-tight, and is protected against immersion effects as defined by the following standards:

- IEC EN60529 to IP66, IP67, IP68
- ISO 20653 to IP69K
- NEMA 4X

Tested ambient

The transmitter is suitable for class D1, non weather-protected locations, outdoor locations (according to IEC 60654-1)

Specification - Performance

Reference conditions according to IEC 62828-1

- Ambient temperature constant in the range 15 – 25 °C (59 – 77 °F)
- Relative humidity constant in the range 50 – 70 %
- Ambient pressure constant in the range 860 – 1060 mbar
- Measuring span based on zero position
- Transmitter with AISI 316 L or Hastelloy C276 process isolating diaphragm
- Filling fluid: Silicone oil
- Supply voltage: 24 V DC ± 1 %
- Load with HART: 250 Ω
- Transmitter not grounded
- Characteristic setting: linear, 4 – 20 mA.

Unless otherwise specified, errors are quoted as % of calibrated span.

Some performance referring to the Upper Range Limit are affected by the actual turndown (TD) as ratio between Upper Range Limit (URL) and calibrated span.

FOR OPTIMUM MEASURING ACCURACY, IT IS RECOMMENDED THAT YOU SELECT THE SENSOR CODE WHICH WILL PROVIDE THE LOWEST TD VALUE.

Dynamic response (according to IEC 61298-2 / IEC 62828-1)

| | |
|---|--------|
| Dead time | 90 ms |
| Time constant (63.2 % of total step response) | 100 ms |

Accuracy rating (ELin)

% of calibrated span, including combined effects of terminal based linearity, hysteresis and repeatability.

| For all sensors | Turndown | Accuracy |
|------------------------------|-------------------|----------------------------------|
| Standard accuracy (± 0.25 %) | from 1:1 to 10:1 | ± 0.25 % |
| | from 10:1 to 20:1 | ± 0.25% + 0.01% x TD – 0.1% |
| Extended accuracy (± 0.10 %) | from 1:1 to 10:1 | ± 0.10 % |
| | from 10:1 to 20:1 | ± 0.01% x TD |
| High accuracy (± 0.075%) | from 1:1 to 5:1 | ± 0.075 % |
| | from 5:1 to 20:1 | ±0.075% + 0.0075% x TD – 0.0375% |

Highest factory configurable turn down 20:1, higher values available on request.

Ambient temperature (EΔTZ+EΔTS)

Temperature effect according to IEC 62828/1

For temperature variation between the limits of –40 °C to +85 °C (-40 °F to +185 °F)

| Sensor | for TD up to | |
|--------|--------------|------------------------------|
| All | 20:1 | ± (0.15 % URL + 0.15 % span) |

In case of maximum ambient temperature variation of 28K, then the following expression could be used as it provides a more accurate interpretation of the effect in that interval.

For 28K temperature variation between the limits of –40 °C to +85 °C (-40 °F to +185 °F)

| Sensor | for TD up to | |
|------------|--------------|------------------------------|
| C, F | 20:1 | ± (0.15 % URL + 0.15 % span) |
| L, D, K, R | 20:1 | ± (0.1 % URL + 0.1 % span) |

Power supply

Within the specified limits for the voltage / load, the total influence is less than 0.005 % of the upper measuring range limit per volt.

Load

Within the specified load / voltage limits, the total influence is negligible.

Mounting position

Nominal position: vertical; process connection at bottom. Mounting positions deviant from the standard position influence the output due to the filling liquid. This effect can be compensated by carrying out zero signal adjustment.

Long-term stability

± 0.25 % of URL over a ten years period

Total performance

For a temperature change from -40° to 85°C (-40° to +185°F) with TD 1:1 and considering IEC 62828-1 expression:

- 0,39 % of calibrated span for standard accuracy models
- 0,32 % of calibrated span for E9 extended accuracy models
- 0,31 % of calibrated span for E7 extended accuracy models

Total performance includes the measuring errors of

- non-linearity including hysteresis and repeatability
- thermal change of the ambient temperature as regards the zero signal and the calibrated span.

$$E_{perf} = \sqrt{(E_{\Delta TZ} + E_{\Delta TS})^2 + E_{Lin}^2}$$

E_{perf} = Total performance

$E_{\Delta TZ}$ = Effect of the ambient temperature on zero

$E_{\Delta TS}$ = Effect of the ambient temperature on span

E_{lin} = Accuracy rating

Specification - Certifications and Approvals

Hazardous atmospheres

INTRINSIC SAFETY Ex ia:

ATEX Europe approval (code HAM)

- II 1 G Ex ia IIC T4 Ga
- II 1/2 D Ex ia IIIC T 135°C Da/Db
- II 1/2 D Ex ta/tb IIIC T 135°C Da/Db

IECEX approval (code HJM)

- Ex ia IIC T4 Ga
- Ex ia IIIC T 135°C Da/Db
- Ex ta/tb IIIC T 135°C Da/Db

CSA Approvals (code HCM)

- For US
 - Class I, Zone 0, AEx ia IIC T4 Ga
 - IS Class I Div 1 Gr A, B, C, D T4
 - IS Class II, Div 1 Gr E, F, G 120° C
 - Zone 20/21 AEx ia IIIC T135° C Da/Db
 - Zone 20/21 AEx ta/tb IIIC T135° C Da/Db
 - Class I, Div. 2 Gr A, B, C, D T4 (PENDING)
 - Class III, Div 1
- For Canada
 - Ex ia IIC T4 Ga
 - IS Class I Div 1 Gr A, B, C, D T4
 - IS Class II, Div 1 Gr E, F, G 120° C
 - Ex ia IIIC T135°C Da/Db
 - Ex ta/tb IIIC T135°C Da/Db
 - Class I, Div. 2 Gr A, B, C, D T4 (PENDING)
 - Class III, Div 1

Combined ATEX Europe, IECEX and CSA (US and Canada) approvals (code HMM)

Without integral display

NEPSI China approval (code HMN)

Without integral display

- INTRINSIC SAFETY Ex ia:
 - Ex ia IIC T4 Ga
 - Ex iaD 20/21 T135°C
 - Ex tD A20/A21 IP6X T135°C

With integral display

NEPSI China approval (code HMN)

With integral display

- INTRINSIC SAFETY Ex ia:
 - Ex ia IIC T4 Ga

IMPORTANT (NOTE)

REFER TO CERTIFICATES FOR PROTECTION CONCEPT, PROCESS TEMPERATURE RANGES AND MAX AMBIENT TEMPERATURE.

Other Approvals

Ministerial decree DM174/2004

Wetted parts in AISI for Pxs100 are approved under ministerial decree nr. DM174/2004 and hence are suitable for drinking water applications.



Hygienic Equipment Design of the EHEDG (PxF100)

PxF100 process connections have been certified according to the EHEDG guidelines and hence are suitable, with appropriate filling fluids, gaskets and installation guidance, for Food and Beverage applications.



Conforming to 3-A Sanitary Standards (PxF100)

PxF100 process connections (with both diaphragm materials Stainless steel and Hastelloy® C-276) have been certified according to the 3-A guidelines and hence are suitable, with appropriate filling fluids, gaskets and installation guidance, for Food and Beverage applications.



European Regulation (EC) No. 1935/2004

Pxx100 uses wetted parts which are in compliance with (EC) No. 1935/2004, see available declaration on www.abb.com/pressure

Specification - Electrical data and options

HART digital communication and 4 to 20 mA output

Power supply

The transmitter operates from 10.5 to 42 V DC with no load and is protected against reversed polarity (additional loads enable operation above 42 V DC).

Minimum operating voltage increases to 14.5 V DC with optional backlit LCD display.

For Ex ia and other intrinsically safe approval power supply must not exceed 30 V DC.

Ripple

Maximum permissible supply voltage ripple during communication complies with HART FSK "Physical Layer" specification rev. 8.1.

Load limitations

Total loop resistance at 4 to 20 mA and HART:

$$R \text{ (k}\Omega\text{)} = \frac{\text{Voltage supply} - \text{Minimum operating voltage (VDC)}}{22 \text{ mA}}$$

A minimum resistance of 250 Ω is required for HART communication.

Glass touch LCD display (optional)

Digital, graphic LCD display with 2-button keypad for customized visualization and configuration.

For 4 to 20 mA analog version

- visualization of output current in mA
- configuration of Zero (4mA) and Span (20mA) using the 2 buttons

For HART/4 to 20 mA version

- visualization of
 - gauge pressure/absolute pressure or
 - output current in mA or %, or
 - HART output
(freely assigned start/end values and unit)
 - diagnostic messages, alarms, errors and measuring range limits violations
 - QR code diagnostics (optional)
- configuration of
 - Zero (4mA) and Span (20mA) using the 2 buttons
 - Easy setup configuration menu

Output signal

4 to 20 mA analog version

- Two-wire, 4 to 20 mA analog output signal

HART/4 to 20 mA version

- Two-wire, 4 to 20 mA analog output signal and digital process variables (% , mA or engineering units) superimposed on the 4 to 20 mA signal with protocol based to Bell 202 FSK standard H.

Output current limits for 4 to 20 mA analog version

Overload condition

- Lower limit: 3.8 mA
- Upper limit: 20.5 mA

Default alarm current

- 21 mA

Output current limits for HART/4 to 20 mA version (according to NAMUR NE 43 standard)

Overload condition

- Lower limit: 3.8 mA (settable from 3.8 to 4 mA)
- Upper limit: 20.5 mA (settable from 20 to 21 mA)

Alarm current

- Lower alarm value: 3.6 mA (settable from 3.6 to 4 mA)
- High alarm value: 21 mA (settable from 20 to 22.8 mA)

Default setting: high alarm current

NAMUR NE 43 defines as alarm limits the lower ≤ 3.6 mA and the upper ≥ 21 mA.

Risk connected to any deviation from NAMUR NE43 thresholds of the alarm current limits falls under Customers' responsibility.

HART release

Revision 7.

Configuration

Transmitter with HART communication and 4 – 20 mA

Standard configuration

Transmitters can be ordered optionally factory calibrated to customers specific range. The required calibrated range and tag will be printed on an additional tag plate. If a calibration range and tag is not required, the transmitter will be supplied as follows:

| | |
|--------------------------|--|
| Engineering Unit | kPa |
| 4 mA | Zero |
| 20 mA | Upper Range Limit (URL) |
| Output | Linear |
| Damping | 1 s |
| Transmitter failure mode | Upscale |
| Tag | Blank (up to 20 alphanumeric characters - long; only last 8 visible on display - short) |
| Optional display | 2 line display view: - PV in kPa for HART version, in mA for 4 to 20 mA version; - output in mA and in percent as bargraph |
| Write protection | Disabled |

Any or all the above configurable parameters, including lower and upper range values which must be the same unit of measure, can be easily changed using a HART hand-held communicator or by a PC running the configuration software with DD or FDI

Tag and Calibration

Tag and/or specific calibrated span shall be ordered using option code SC.

In case a calibration report is needed on a full range device, option code SC has to be ordered and full span has to be provided as calibrated span.

In case option SC is ordered for tag purposes, two tag types are available: Short Tag and Long Tag.

See below table for details about tag type applicability / presence:

| Type | Max Length | On Display | On Certification | On Device Label |
|-----------|------------|------------|------------------|-----------------|
| Short Tag | 8 digits | YES | YES | NO |
| Long Tag | 32 digits | NO | YES | YES |

In order to enable Tag (either Long / Short or both) option SC is mandatory in the code

In case no specific indication will be given about the tag type, data will be considered as Long Tag by default.

In case tag is required on the optional wired-on customer data plate (optional digit LEW) specific indication needs to be given.

Mounting dimensions

(not design data) - dimensions in mm (inch)

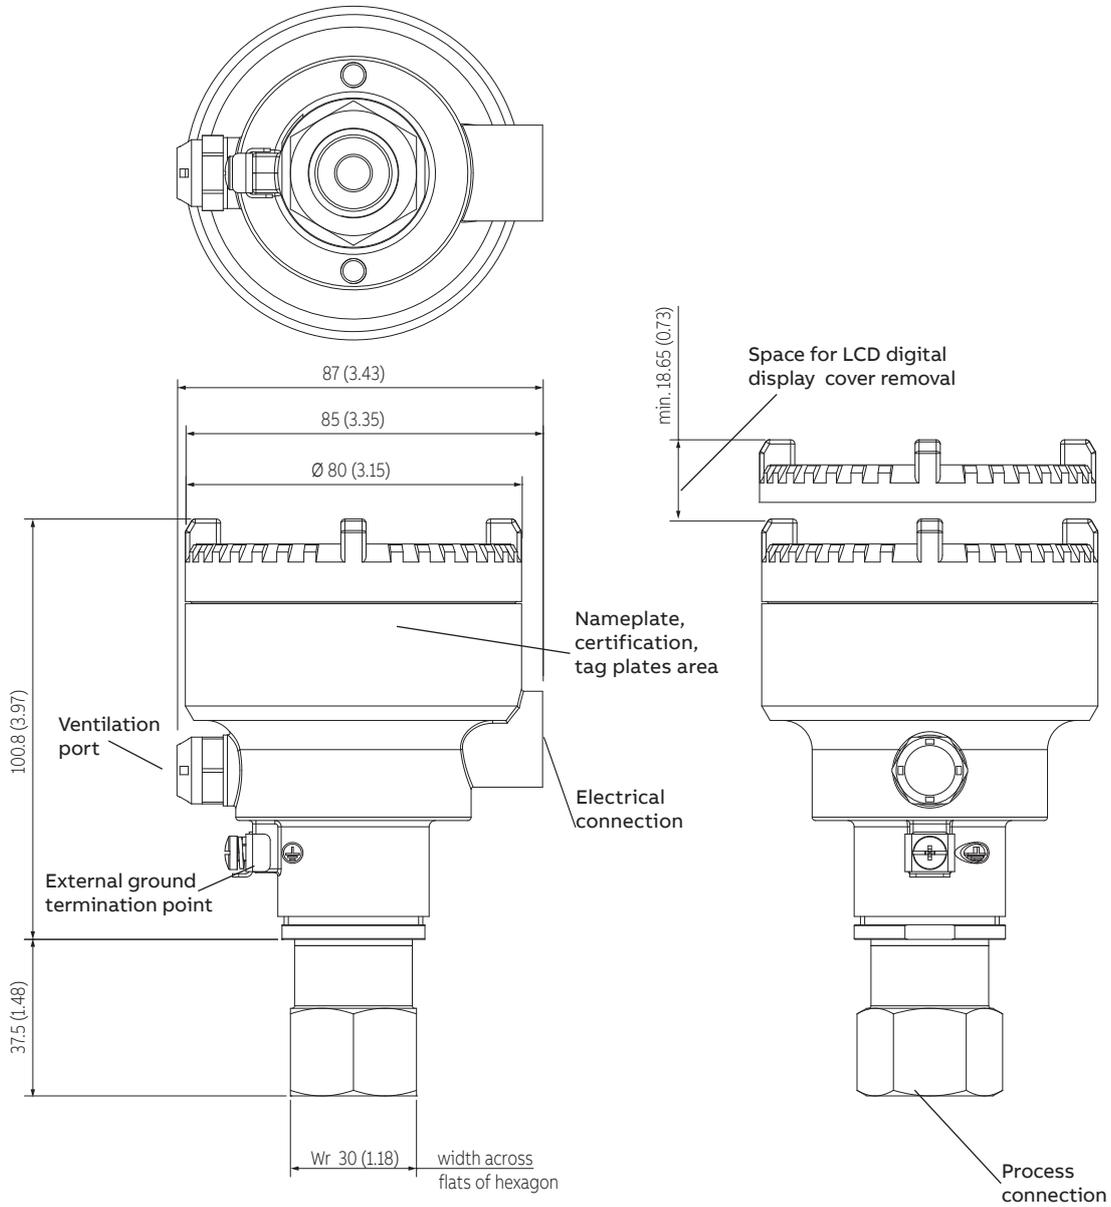


Figure 1 PxS100 with 1/2 in NPT female connection and LCD digital display

...Mounting dimensions

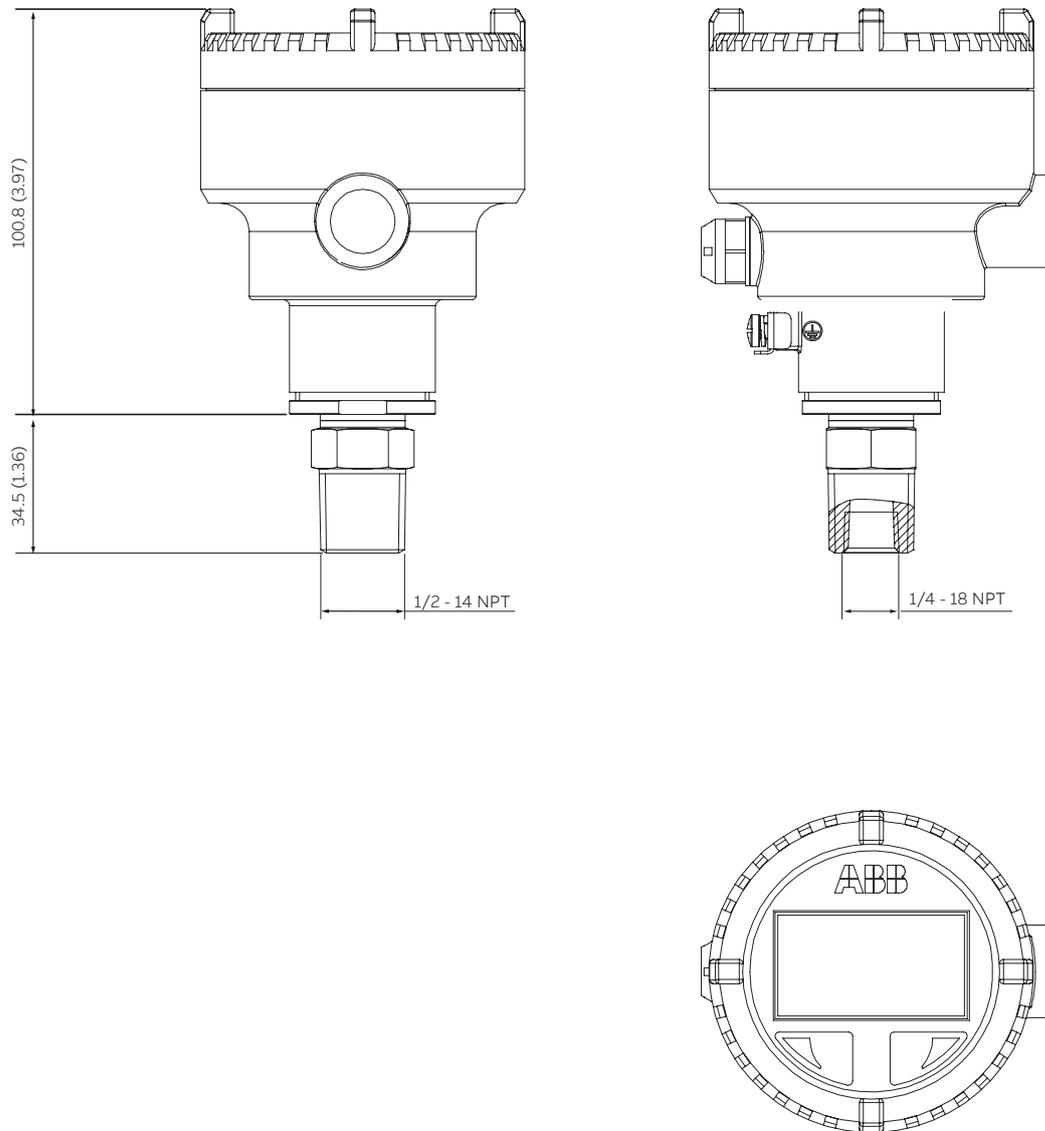


Figure 2 PXS100 with 1/2 in NPT male / 1/4 in NPT female connection

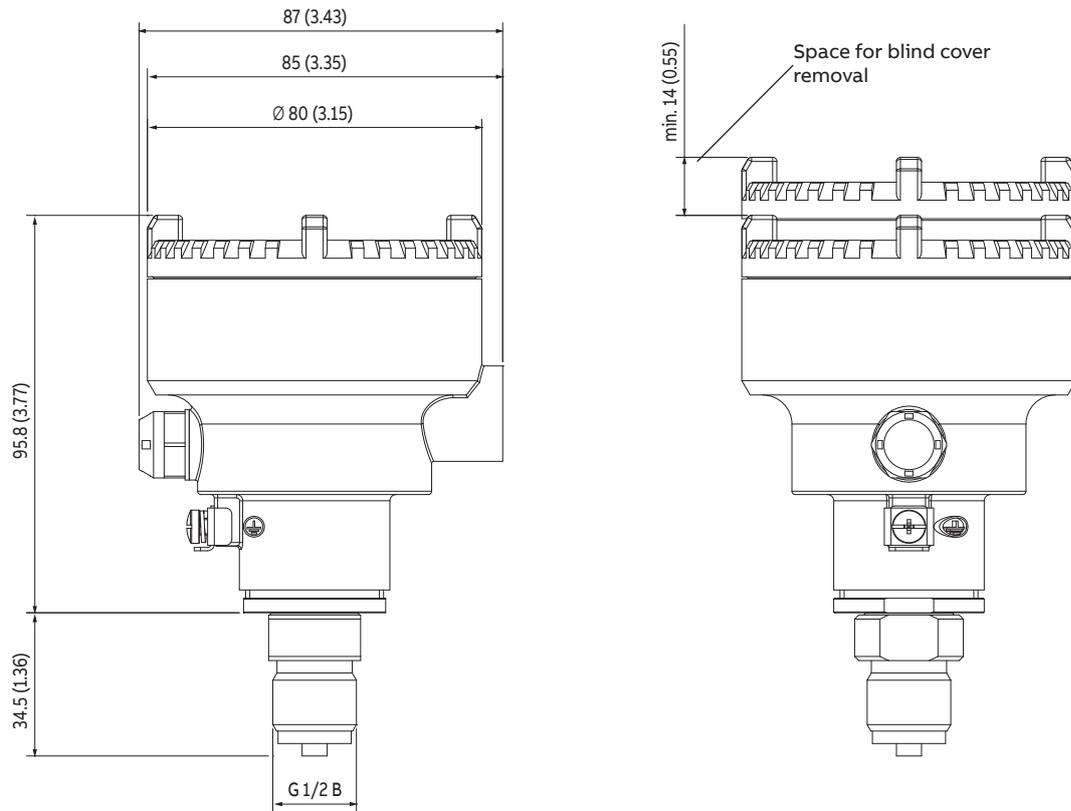


Figure 3 PXS100 with DIN-EN837-1 G 1/2 B connection

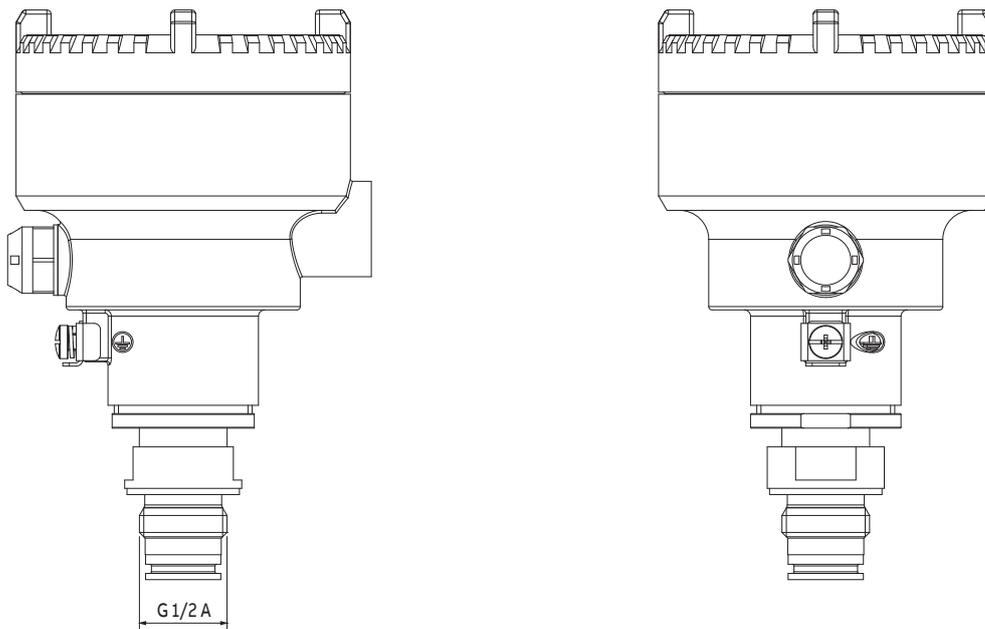


Figure 4 PXS100 with front bonded diaphragm connection

...Mounting dimensions

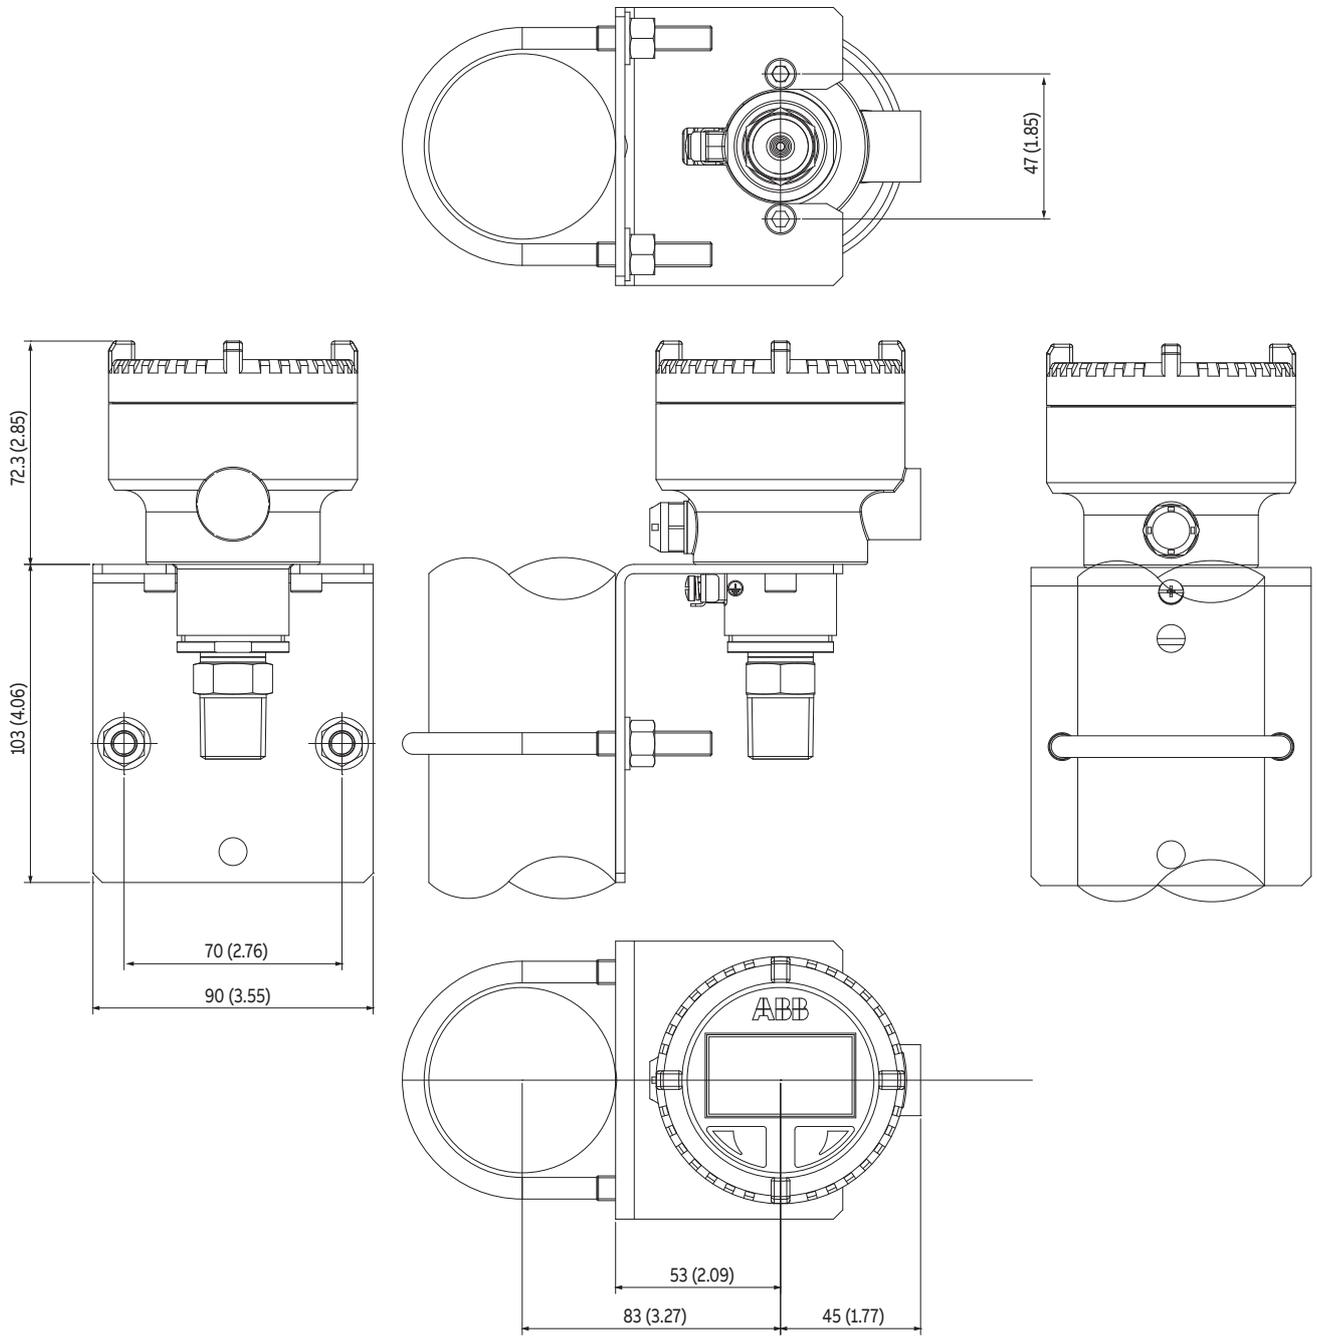


Figure 5 Pxs100 with 1/2 in NPT male / 1/4 in NPT female connection on bracket

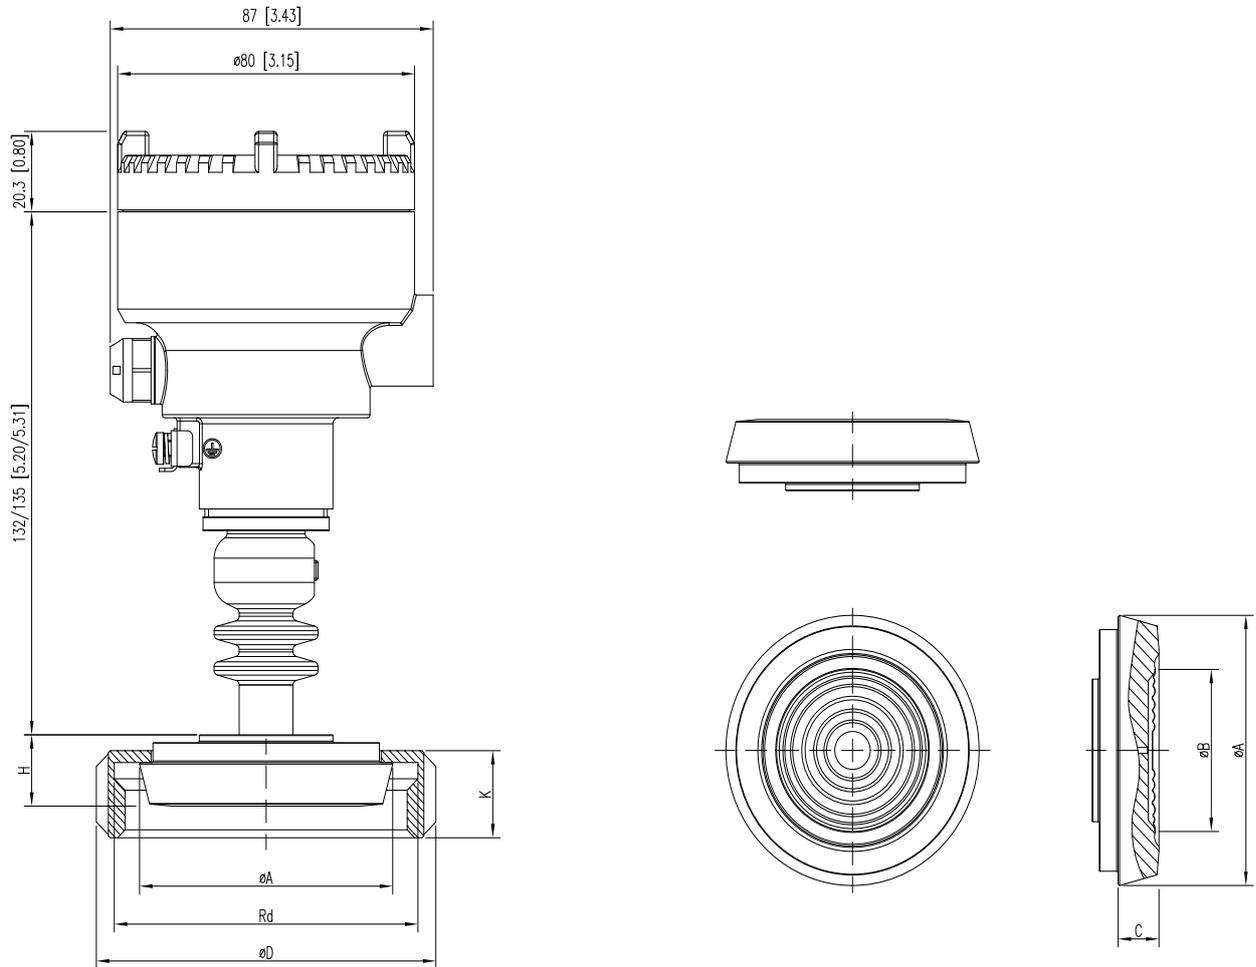


Figure 6 PXF100 with DIN11851

| Size/ Rating | PN | A (dia) | B (dia) | C | D (dia) | Rd | H | K |
|--------------|----|-------------|-----------|-----------|-----------|--------|-----------|-----------|
| DN40 | 40 | 55,8 [2,20] | 38 [1,50] | 10 [0,39] | 78 [3,07] | 65x1/6 | 15 [0,59] | 21 [0,83] |
| DN50 | 25 | 68,2 [2,69] | 41 [1,61] | 11[0,43] | 92 [3,62] | 78x1/6 | 18 [0,71] | 22 [0,87] |

...Mounting dimensions

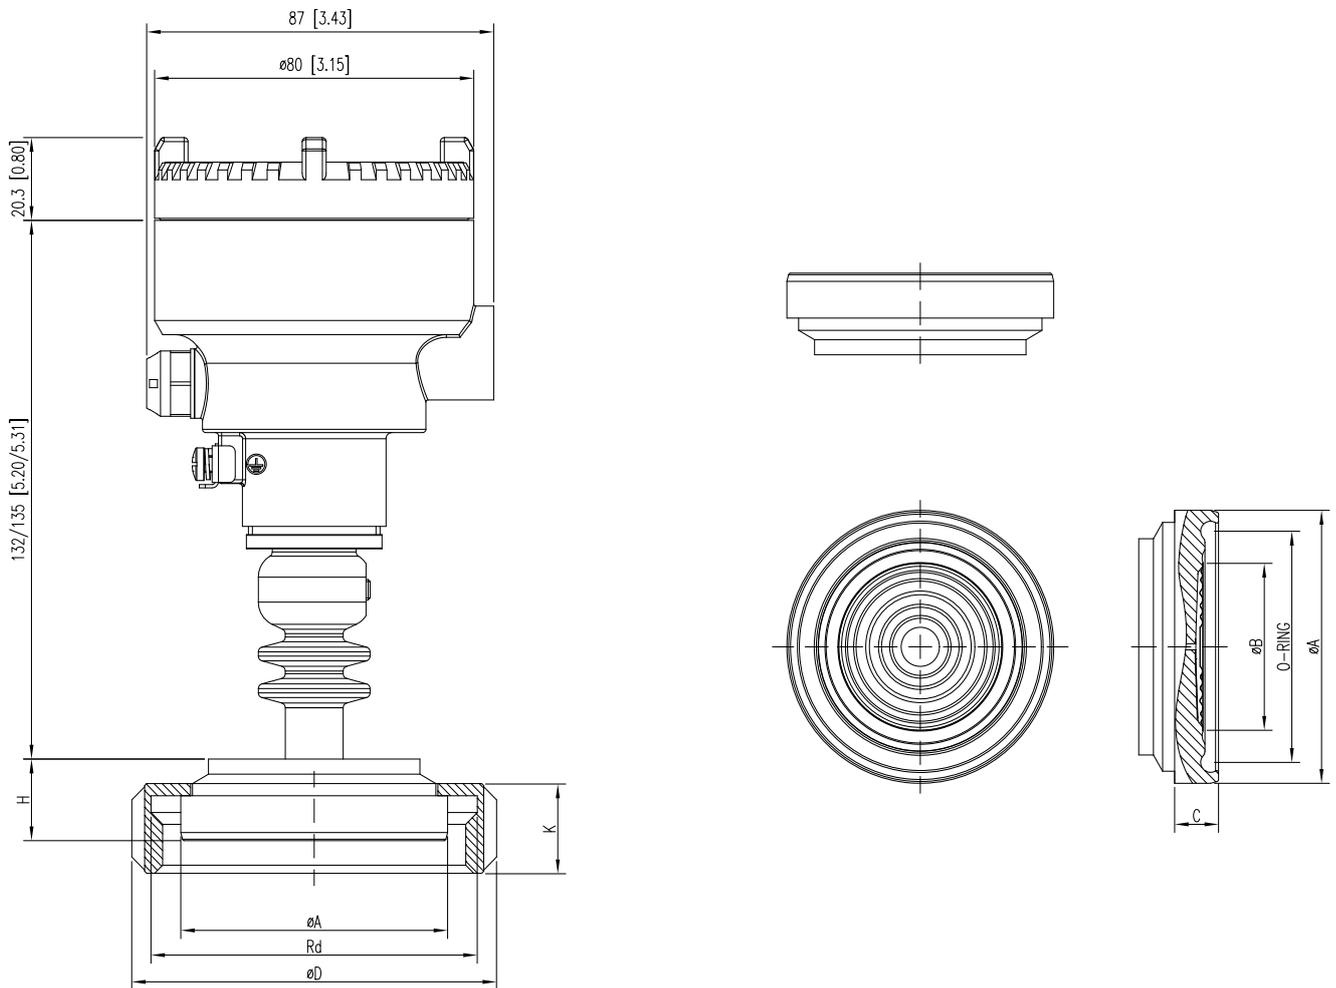


Figure 7 PXF100 with DIN11864 -1 FORM A

| Size/ Rating | PN | A (dia) | B (dia) | C | D (dia) | Rd | H | K | O-RING |
|--------------|----|-------------|-----------|-----------|-----------|--------|-----------|-----------|--------|
| DN40 | 40 | 54,9 [2,16] | 35 [1,38] | 10 [0,39] | 78 [3,07] | 65x1/6 | 20 [0,79] | 21 [0,83] | 40x5 |
| DN50 | 25 | 66,9 [2,63] | 41 [1,61] | 11 [0,43] | 92 [3,62] | 78x1/6 | 20 [0,79] | 22 [0,87] | 52x5 |

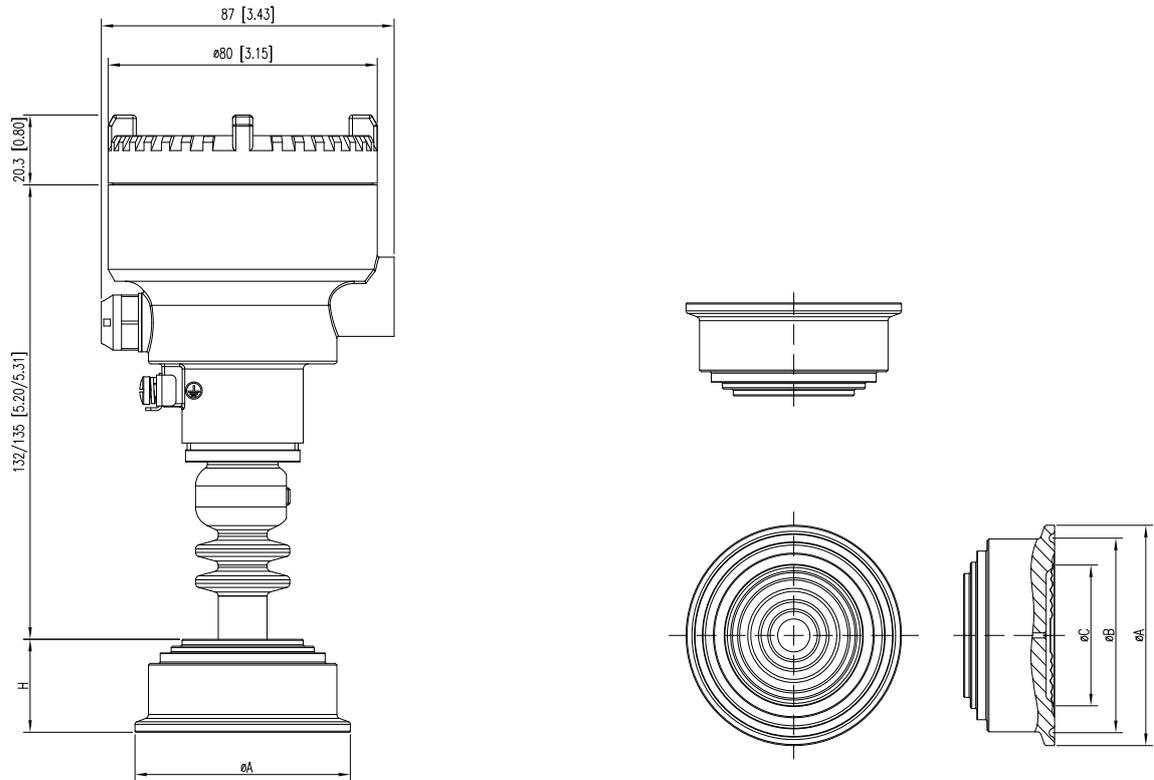


Figure 8 PXF100 with TRI CLAMP ISO 2852

| Size/ Rating | PN | A (dia) | B (dia) | C (dia) | H |
|---------------|----|-------------|-------------|-------------|-------------|
| 1" - DN25 | 40 | 50,5 [1,99] | 43,5 [1,71] | 22,5 [0,89] | 21,5 [0,85] |
| 1" 1/2 - DN38 | 40 | 50,5 [1,99] | 43,5 [1,71] | 35 [1,38] | 21,5 [0,85] |
| 2" - DN51 | 38 | 64 [2,52] | 56,5 [2,22] | 41 [1,61] | 27 [1,06] |
| 3" - DN76,1 | 24 | 91 [3,58] | 83,5 [3,29] | 72 [2,83] | 27 [1,06] |
| 4" - DN101,6 | 17 | 119 [4,69] | 110 [4,33] | 72 [2,83] | 27 [1,06] |

...Mounting dimensions

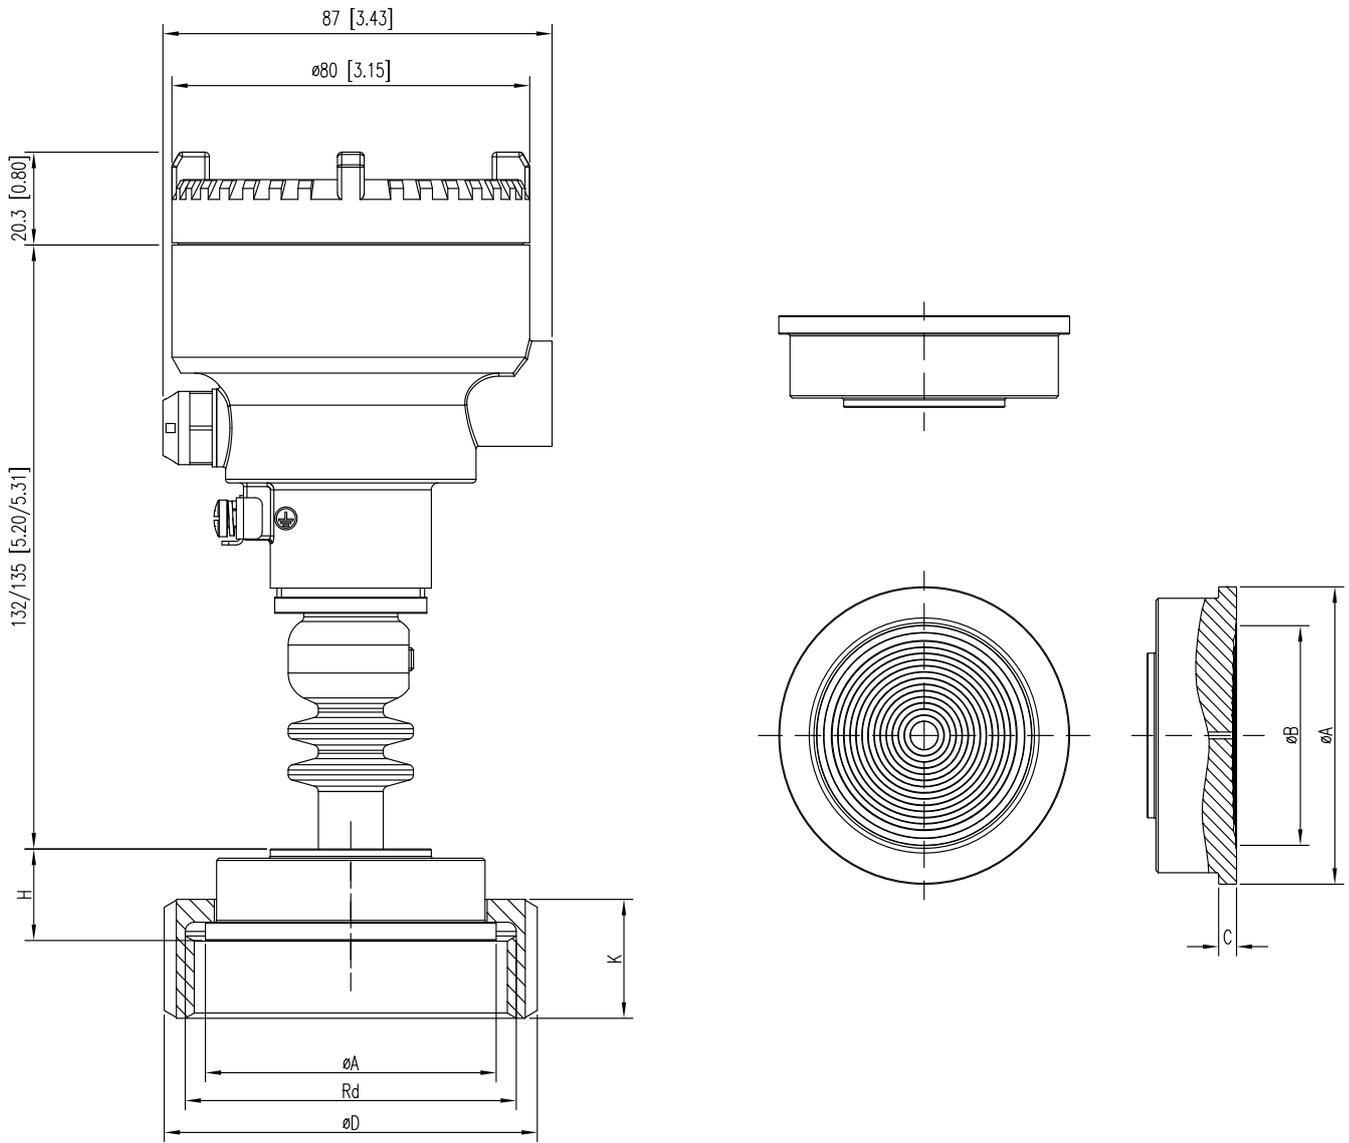


Figure 9 PXF100 with SMS SS1145

| Size/ Rating | PN | A (dia) | B (dia) | C | D (dia) | Rd | H | K |
|--------------|----|-----------|-----------|----------|-----------|------|-----------|-----------|
| SMS 38 | 40 | 55 [2,17] | 35 [1,38] | 4 [0,16] | 74 [2,91] | 60-6 | 20 [0,79] | 25 [0,98] |
| SMS 51 | 40 | 65 [2,56] | 48 [1,89] | 4 [0,16] | 84 [3,31] | 70-6 | 20 [0,79] | 26 [1,02] |

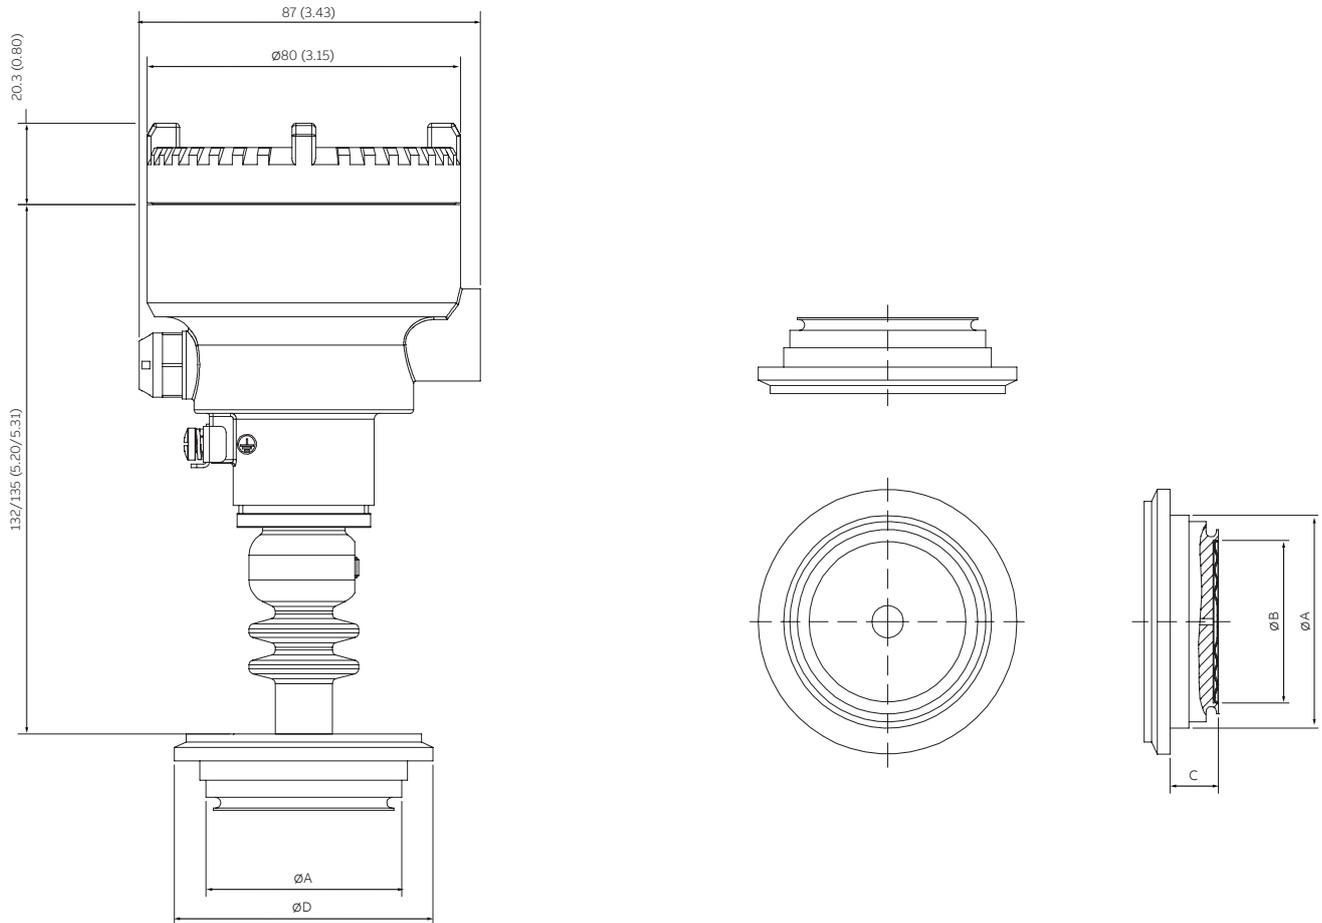


Figure 10 PXF100 with Varinline®

| Size/ Rating | PN | A (dia) | B (dia) | C | D (dia) |
|--------------|----|-----------|-----------|-------------|-----------|
| F DN25 | 25 | 50 [1,97] | 40 [1,58] | 12,3 [0,48] | 66 [2,60] |
| N DN40 | 25 | 68 [2,68] | 60[2,68] | 12,3 [0,48] | 84 [3,31] |

...Mounting dimensions

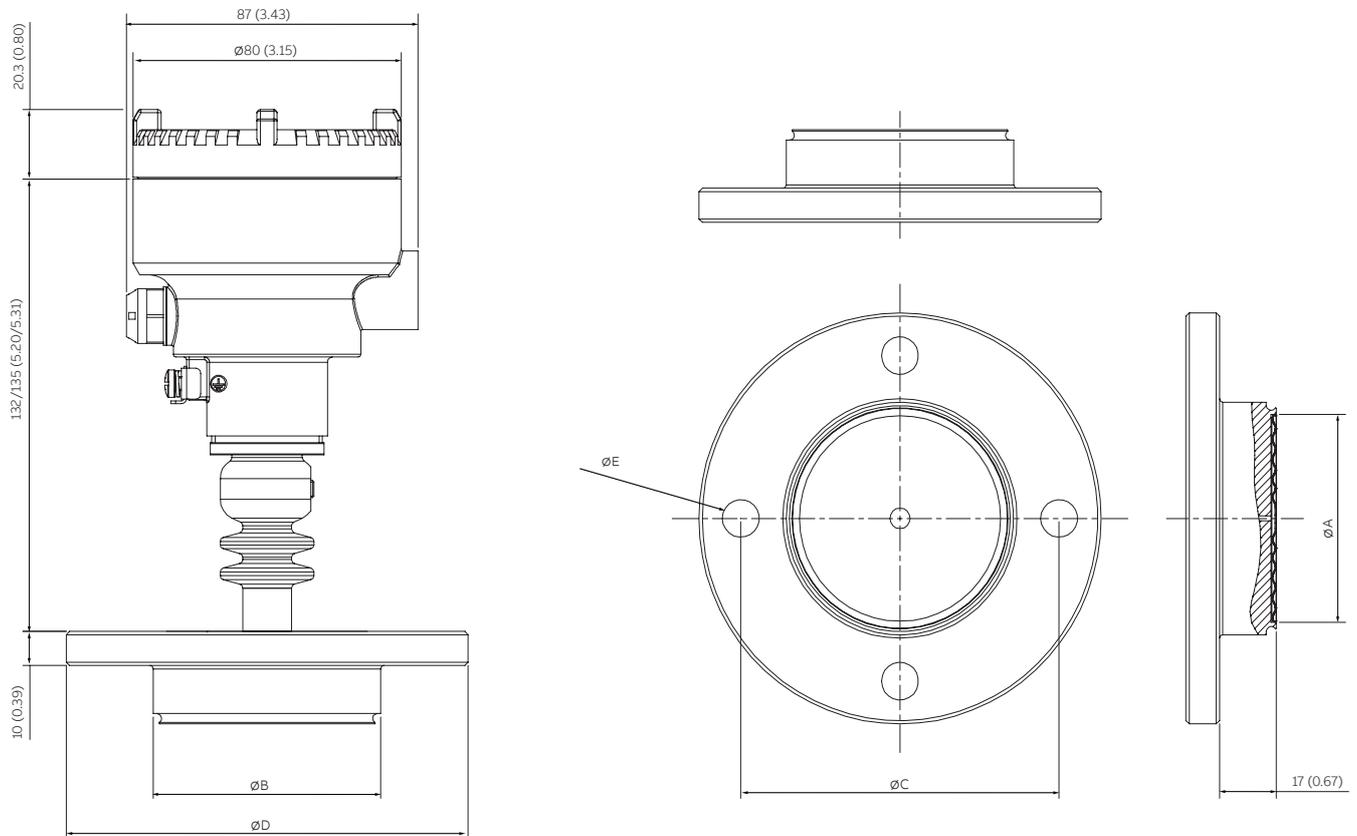


Figure 11 PXF100 with Neumo Biocontrol®

| Size/ Rating | PN | A (dia) | B (dia) | C (dia) | D (dia) | 4 x E (dia) |
|--------------|----|-----------|-----------|-----------|------------|-------------|
| D50 | 16 | 40 [1,57] | 50 [1,97] | 70 [2,76] | 90 [3,54] | 9 [0,35] |
| D65 | 16 | 59 [2,32] | 68 [2,68] | 95 [3,74] | 120 [4,72] | 11 [0,43] |

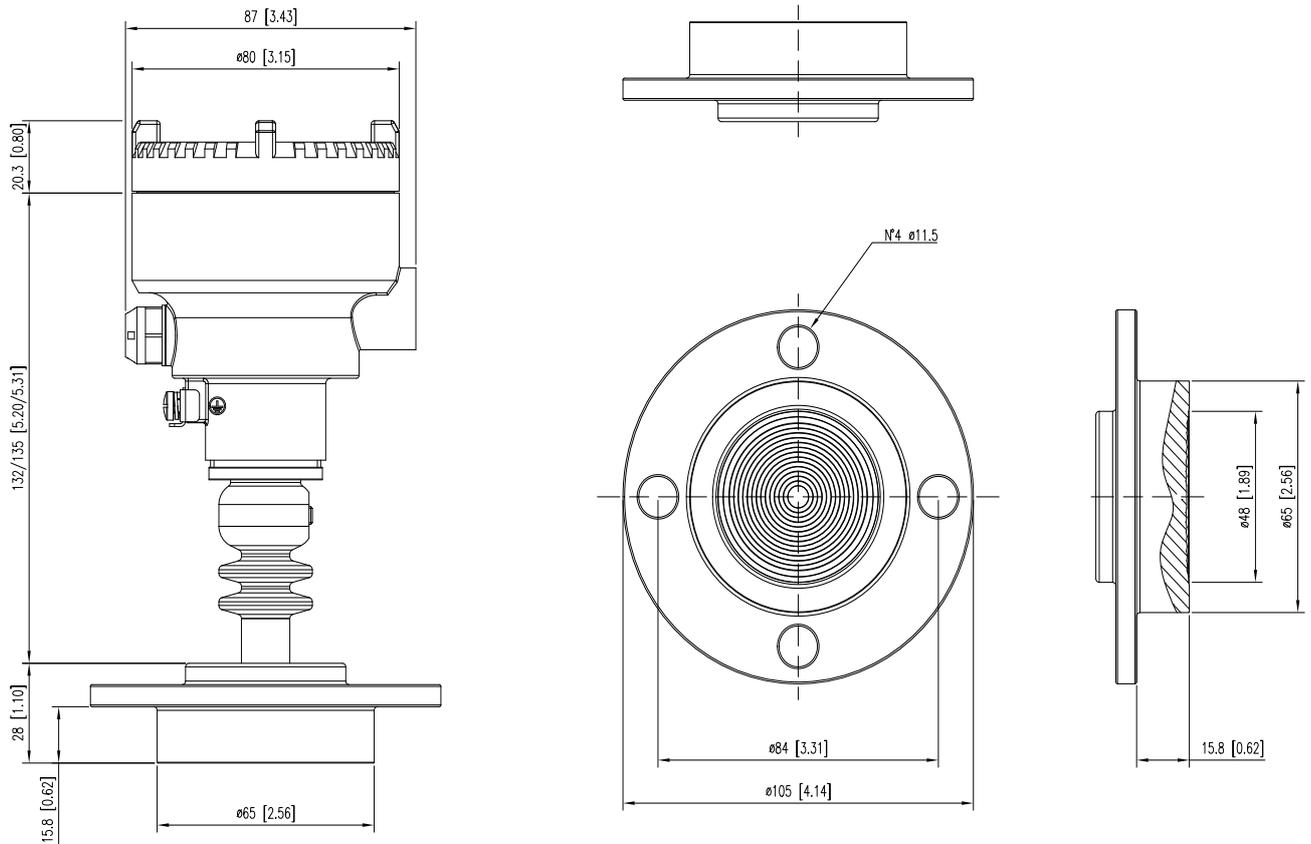


Figure 12 PXF100 with DRD

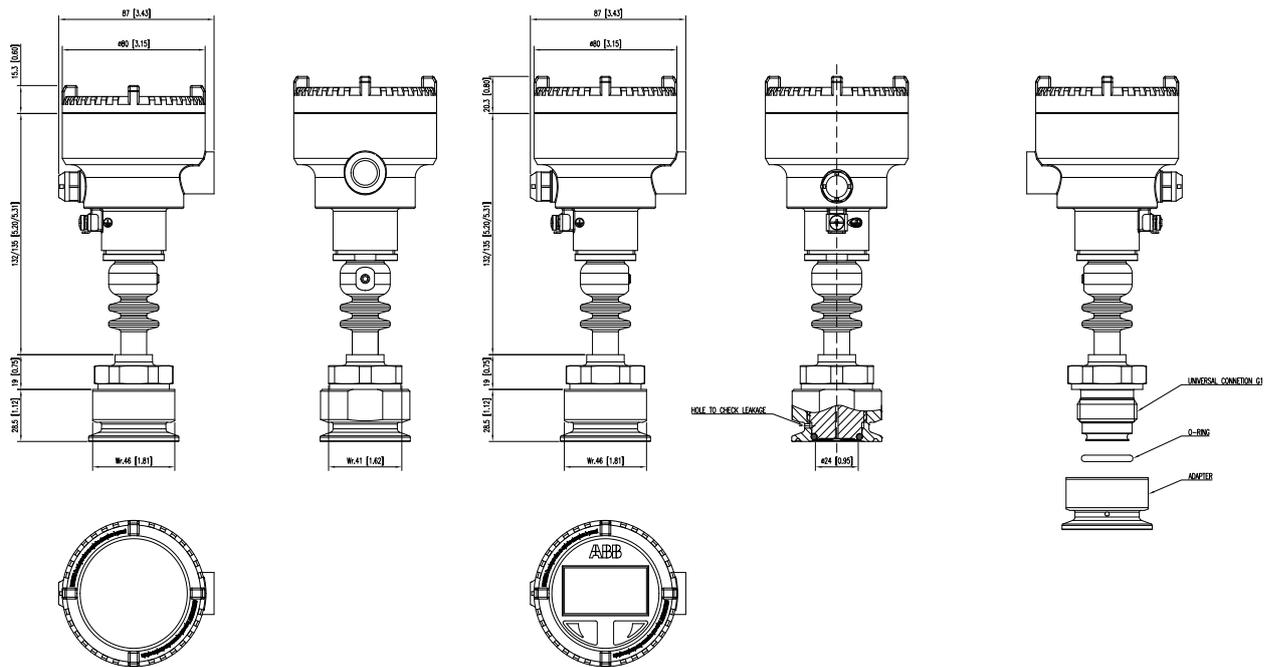


Figure 13 PXF100 with Universal connection and hygienic adapter

...Mounting dimensions

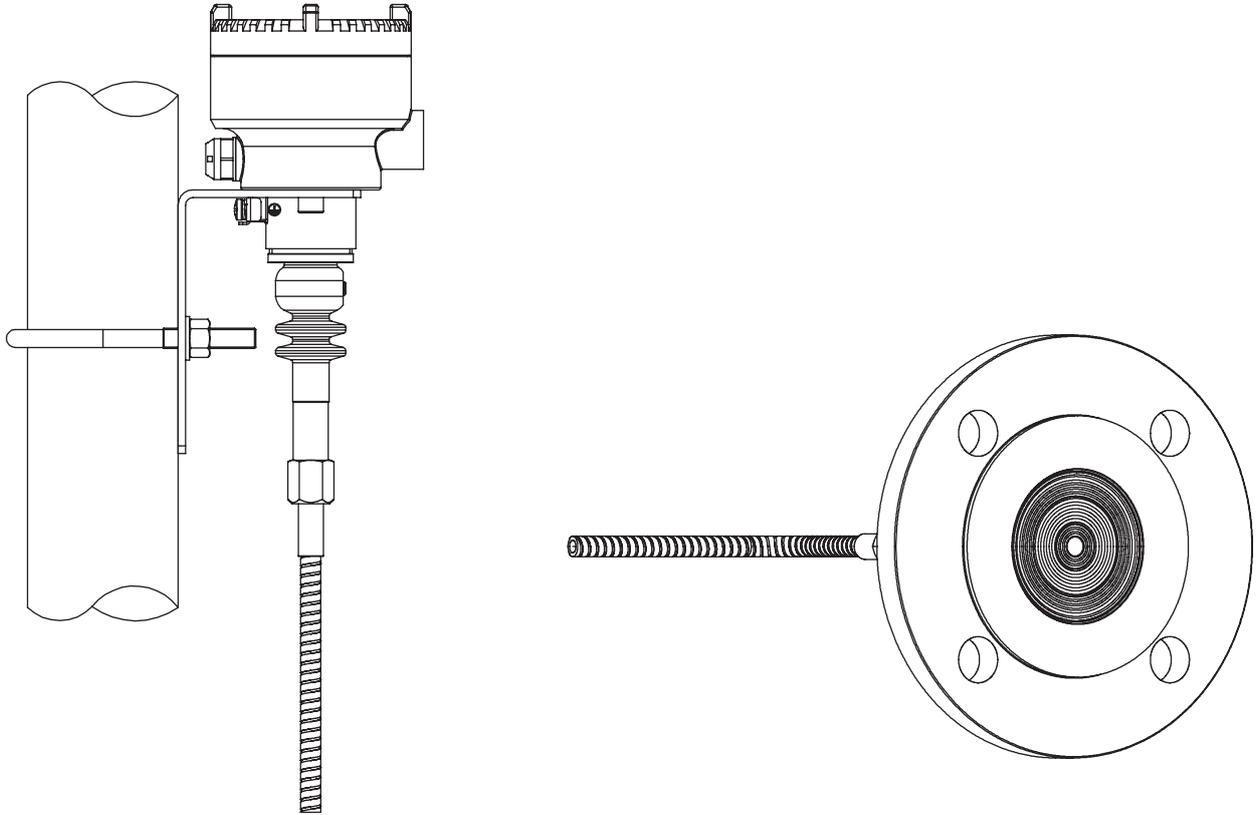


Figure 14 PxD100 with remote seal.
(This is only a representative drawing. For detailed drawings of the remote seal please refer to the S26 datasheet)

Electrical connections

HART version

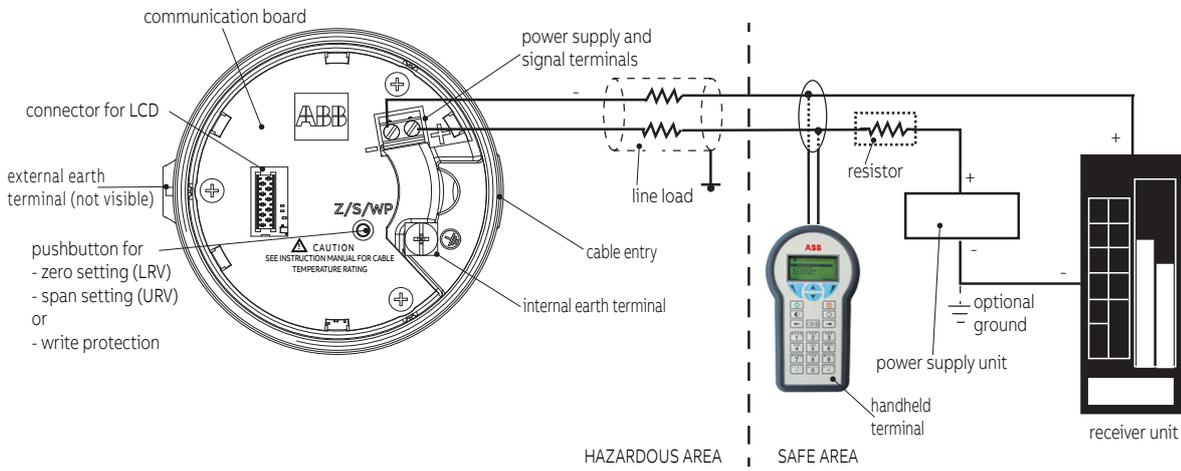


Figure 15 Connections

HART communication requires a minimum loop resistance of 250 ohm. If this is less than 250 ohm, additional resistance should be added.

Additional ordering information model PGS100 Gauge Pressure Transmitters and PAS100 Absolute Pressure Transmitters
 Add one or more options code after the basic ordering information to select all required options.

| | XX | XX | XXX | XX | XX | XX | XX | XX |
|--|-------------|----|-----|----|----|----|----|----|
| Display (see FOOTNOTE) | | | | | | | | |
| Glass touch LCD display with 2-button keypad | D3 | | | | | | | |
| Backlit glass touch LCD display with 2-button keypad | D4 | | | | | | | |
| Extended performances | | | | | | | | |
| ± 0,075% extended Base accuracy | | E7 | | | | | | |
| ± 0.10 % extended base accuracy | | E9 | | | | | | |
| Hazardous area certifications (see relevant paragraph for complete detailed markings) | | | | | | | | |
| ATEX Ex ia and Ex ta/tb | (Note 4) | | HAM | | | | | |
| CSA approvals (USA and Canada) IS (Gas and Dust) | (Note 4) | | HCM | | | | | |
| IECEX Ex ia and Ex ta/tb | (Note 4) | | HJM | | | | | |
| Combined ATEX, CSA approvals (USA and Canada) and IECEx (Gas and Dust) | (Note 4) | | HMM | | | | | |
| NEPSI China (Ex ia and Ex iaD / Ex tD) | | | HMN | | | | | |
| INMETRO (Brazil) Ex ia and Ex ta/tb | | | HMB | | | | | |
| EAC Ex ia and Ex ta/tb | | | HME | | | | | |
| Approvals | | | | | | | | |
| CSA ordinary location (USA and Canada) | (Note 4) | | GO | | | | | |
| DM174 water approval | (Note 5) | | GD | | | | | |
| WRAS water approval (PENDING) | (Note 5) | | GW | | | | | |
| Combined water approvals | (Note 5) | | GA | | | | | |
| Physical application | | | | | | | | |
| Oxygen service cleaning, (only available with inert oil fill) Pmax =10 MPa for Galden; Tmax=60 °C/140 °F or max. working pressure | (Note 6) | | | | P1 | | | |
| Accessories | | | | | | | | |
| External grounding terminal (fitted as standard if hazardous area certification code Hxx is selected) | | | | | | | AG | |
| Manifold assembly | (Note 7, 8) | | | | | | AM | |
| Mounting bracket | | | | | | | | |
| Universal for pipe or wall mounting / AISI 304 ss (1.4301) | | | | | | | | BU |
| Software application | | | | | | | | |
| Calibration to specified measuring span and/or tag number (and printed on plastic label) | (Note 9) | | | | | | | SC |
| Alarm setting to low current of 3.6 mA | | | | | | | | SA |
| Digital access diagnostics (requires backlit LCD display code D4) | | | | | | | | SD |
| Local configuration (Easy Set Up) for 4..20mA Version | (Note 10) | | | | | | | SE |

NOTE - Refer to hazardous atmospheres paragraph for compliance of digital display

...Ordering Information

...Additional ordering information model PGS100 Gauge Pressure Transmitters and PAS100 Absolute Pressure Transmitters

| | XX | XXX | XX |
|--|----|-----|----|
| Inspection/compliance certificates | | | |
| Inspection certificate EN 10204–3.1 of calibration (5-point) (Note 11) | CF | | |
| Inspection Certificate UNI EN 10204 3.1 (9 points calibration) (Note 12) | CN | | |
| Inspection certificate EN 10204–3.1 of cleanliness stage | CC | | |
| Inspection certificate EN 10204–3.1 of helium leakage test of the sensor module | CL | | |
| Inspection certificate EN 10204–3.1 of the pressure test | CH | | |
| Certificate of compliance with the order EN 10204–2.1 of instrument design | CD | | |
| Inspection certificate EN 10204–3.1 of process wetted parts | CM | | |
| Certificate of compliance with the order EN 10204–2.1 of pressure bearing and wetted parts | CW | | |
| Labels | | | |
| Label and display visualization in imperial units (Pressure = inH2O/ psi at 68 °F; Temperature = deg. F) | | LTU | |
| Supplemental wired-on stainless steel plate (4 lines, 32 characters each) | | LEW | |
| Label and display visualization in Chinese | | LTS | |
| Manuals | | | |
| German | | | M1 |
| Italian (PENDING) | | | M2 |
| Spanish (PENDING) | | | M3 |
| French (PENDING) | | | M4 |
| English | | | M5 |
| Chinese (PENDING) | | | M6 |
| Portuguese (PENDING) | | | MA |
| Russian (PENDING) | | | MB |

- Note 1: Only available with Front bonded G 1/2 in process connection code P
- Note 2: For 10000 kPa/100 bar/1450 psi sensor code R, H-Shield is only available with front bonded G 1/2 in process connection code P
- Note 3: Not available with 40 kPa/400 mbar/160 inH2O/300 mmHg sensor code F
- Note 4: Hazardous area certification and CSA ordinary location options are mutually exclusive
- Note 5: Available only with Diaphragm material code A
- Note 6: Not available with DIN EN 837-1 G 1/2 B process connection code C
- Note 7: Not available with any Ex certificates.
- Note 8: Not available with Physical application code P1
- Note 9: Option code SC has to be ordered if 0 to URL calibration record is required
- Note 10: Available only with Output code A
- Note 11: Option code CF provides an inspection certificate of calibration 0 to URL
Option code SC should be also selected if the inspection certificate is required for calibration different from 0 to URL
- Note 12: Mutually exclusive with Inspection certificate code CF

Standard delivery items (can be differently specified by additional ordering code)

- For general purpose applications (no Ex application certification)
- EPDM O-ring for G 1/2 front bonded process connection, flush diaphragm
- No display, no mounting bracket
- Short-form leaflet instruction and labels in English
- Configuration with kPa and deg. C units
- No test, inspection or material traceability certificates

IMPORTANT REMARK FOR ALL MODELS

THE SELECTION OF SUITABLE WETTED PARTS AND FILLING FLUID FOR COMPATIBILITY WITH THE PROCESS MEDIA IS A CUSTOMER'S RESPONSIBILITY, IF NOT OTHERWISE NOTIFIED BEFORE MANUFACTURING.

Ordering Information

Basic ordering information PGF100 Gauge Pressure Transmitters and PAF100 Absolute Pressure Transmitters

Select one character or set of characters from each category and specify complete catalog number.

Refer to additional ordering information and specify one or more codes for each transmitter if additional options are required.

| | | | | | | | |
|---|-----------|------------------------|------------|---|---|---|---|
| Base model – 1st to 6th characters | | | X | X | X | X | X |
| Gauge pressure transmitter, compact class, base accuracy 0.1 % | | | PGF100 | | | | |
| Absolute pressure transmitter, compact class, base accuracy 0.1 % | | | PAF100 | | | | |
| Sensor range – 7th character | | | | | | | |
| 6 kPa | 60 mbar | 24 inH2O | C | | | | |
| 40 kPa | 400 mbar | 160 inH2O (300 mmHg) | F | | | | |
| 250 kPa | 2500 mbar | 1000 inH2O (1875 mmHg) | L | | | | |
| 1000 kPa | 10 bar | 145 psi | D | | | | |
| 4000 kPa | 40 bar | 580 psi | K | | | | |
| 10000 kPa | 100 bar | 1450 psi | (Note 1) R | | | | |
| Maximum working pressure – 8th and 9th characters | | | | | | | |
| Standard by design according to sensor range | | | S9 | | | | |
| Diaphragm material – 10th character | | | | | | | |
| AISI 316 L ss | | | | | A | | |
| Hastelloy C-276 | | | (Note 2) | | H | | |
| Diaflex antiabrasion coating on AISI 316 L ss | | | (Note 2) | | F | | |
| Diaflex antiabrasion coating on Hastelloy C-276 | | | (Note 2) | | C | | |
| Fill fluid – 11th character | | | | | | | |
| Silicone oil | | | | | | 1 | |
| Inert oil | | | | | | 2 | |
| Mineral white oil (FDA) | | | | | | 3 | |
| Vegetal white oil (FDA) | | | | | | 5 | |
| Process connection material – 12th character | | | | | | | |
| AISI 316 L ss | | | | | | | A |

...Ordering Information

... Basic ordering information PGF100 Gauge Pressure Transmitters and PAF100 Absolute Pressure Transmitters

| | X | X | X | X |
|--|---|---|---|---|
| Process connection size – 13th character | | | | |
| Front bonded G 1 in hygienic (adapter-compatible) (Note 3, 5, 8) | U | | | |
| Tri-Clamp ISO2852 DN38 (1 1/2 in), DIN 32676 DN40 (Note 4, 7, 9) | A | | | |
| Tri-Clamp ISO2852 DN 25 (1"), DIN 32676 DN 25 (Note 4, 7, 9) | T | | | |
| Tri-Clamp ISO2852 DN 51 (2 in), DIN 32676 DN 50 (Note 4, 7, 9) | B | | | |
| Tri-Clamp ISO2852 DN 76.1 (3 in), DIN 32676 DN65 (Note 7, 9) | C | | | |
| Tri-Clamp ISO2852 DN 101.6 (4 in) DIN 32676 DN 100 (Note 7, 9) | D | | | |
| DRD 65mm (DN 50) (Note 4, 7, 9) | E | | | |
| Dairy 11851 DN40 PN40 (Note 4, 6, 7, 9) | F | | | |
| Dairy 11851 DN50 PN25 (Note 4, 6, 7, 9) | G | | | |
| SMS 1 1/2 in PN40 (dia 35) (3A approval PENDING) (Note 7) | H | | | |
| SMS 2 in PN40 (dia 45) (3A approval PENDING) (Note 7) | L | | | |
| Varinline® F DN25 (Note 7, 9) | M | | | |
| Varinline® N DN40 (Note 7, 9) | N | | | |
| Neumo Biocontrol® D50 (Note 7, 9) | P | | | |
| Neumo Biocontrol® D65 (Note 7, 9) | Q | | | |
| Dairy DIN 11864-1 typeA DN40 PN16 (Note 7, 9) | R | | | |
| Dairy DIN 11864-1 typeA DN50 PN16 (Note 7, 9) | S | | | |
| Bolts and gaskets – 14th character | | | | |
| None | | Y | | |
| Housing material / Electrical connection – 15th character | | | | |
| AISI 316 L ss / M16 x 1.5 thread | | | U | |
| AISI 316 L ss / M20 x 1.5 female thread (through adapter - supplied loose) | | | T | |
| AISI 316 L ss / 1/2 in -14 NPT female thread (through adapter - supplied loose) | | | S | |
| Protocol/Output – 16th characters | | | | |
| 4 – 20 mA analog signal only (only zero/span settings are available) | | | | A |
| HART digital communication and 4 – 20 mA (Easy setup menu is available for configuration settings) | | | | H |

Additional ordering information model PGF100 Gauge Pressure Transmitters and PAF100 Absolute Pressure Transmitters
 Add one or more options code after the basic ordering information to select all required options.

| | XX | XX | XXX | XX | XX | XX | XX |
|--|--------------|----|-----|----|----|----|----|
| Display (see FOOTNOTE) | | | | | | | |
| Glass touch LCD display with 2-button keypad | D3 | | | | | | |
| Backlit glass touch LCD display with 2-button keypad | D4 | | | | | | |
| Extended performances | | | | | | | |
| ± 0.075 % extended base accuracy | | E7 | | | | | |
| Hazardous area certifications (see relevant paragraph for complete detailed markings) | | | | | | | |
| ATEX Ex ia and Ex ta/tb | (Note 10) | | HAM | | | | |
| CSA approvals (USA and Canada) IS (Gas and Dust) | (Note 10) | | HCM | | | | |
| IECEX Ex ia and Ex ta/tb | (Note 10) | | HJM | | | | |
| Combined ATEX, CSA approvals (USA and Canada) and IECEX (Gas and Dust) | (Note 10) | | HMM | | | | |
| Approvals | | | | | | | |
| CSA ordinary location (USA and Canada) (PENDING) | (Note 10) | | | GO | | | |
| Combined 3A & EHEDG approvals | (Note 9, 11) | | | GF | | | |
| Physical application | | | | | | | |
| Vacuum-proof design | | | | | P8 | | |
| Accessories | | | | | | | |
| External grounding terminal (fitted as standard if hazardous area certification code Hxx is selected) | | | | | | | AG |
| Software application | | | | | | | |
| Calibration to specified measuring span and/or tag number (and printed on plastic label) | (Note 12) | | | | | | SC |
| Alarm setting to low current of 3.6 mA | | | | | | | SA |
| Digital access diagnostics (requires backlit LCD display code D4) | | | | | | | SD |
| Local configuration (Easy Set Up) for 4..20mA Version | (Note 13) | | | | | | SE |

NOTE - Refer to hazardous atmospheres paragraph for compliance of digital display

...Ordering Information

| | XX | XXX | XX | XX |
|--|----|-----|----|----|
| Inspection/compliance certificates | | | | |
| Inspection certificate EN 10204–3.1 of calibration (5-point) (Note 14) | CF | | | |
| Inspection Certificate UNI EN 10204 3.1 (9 points calibration) (PENDING) (Note 15) | CN | | | |
| Inspection certificate EN 10204–3.1 of cleanliness stage | CC | | | |
| Inspection certificate EN 10204–3.1 of helium leakage test of the sensor module | CL | | | |
| Inspection certificate EN 10204–3.1 of the pressure test | CH | | | |
| Certificate of compliance with the order EN 10204–2.1 of instrument design | CD | | | |
| Inspection certificate EN 10204–3.1 of process wetted parts | CM | | | |
| Certificate of compliance with the order EN 10204–2.1 of pressure bearing and wetted parts | CW | | | |
| Labels | | | | |
| Label and display visualization in imperial units (Pressure = inH2O/ psi at 68 °F; Temperature = deg. F) | | LTU | | |
| Supplemental wired–on stainless steel plate (4 lines, 32 characters each) | | LEW | | |
| Label and display visualization in Chinese | | LTS | | |
| Manuals | | | | |
| German | | | M1 | |
| Italian (PENDING) | | | M2 | |
| Spanish (PENDING) | | | M3 | |
| French (PENDING) | | | M4 | |
| English | | | M5 | |
| Chinese (PENDING) | | | M6 | |
| Portuguese (PENDING) | | | MA | |
| Russian (PENDING) | | | MB | |
| Other Accessories | | | | |
| EPDM o-ring for F&B (3A, FDA, EHEDG) and drinkable water (Note 16) | | | | RF |
| FKM for F&B (3A, FDA, EC 1935/2004) -20°C / +200°C (Note 16) | | | | RK |
| HNBR for F&B (3A, FDA, EC 1935/2004) -40°C / +180°C (Note 16) | | | | RN |

Note 1: Not available with Diaphragm material F,C,S & Process connection size code U

Note 2: Only available with process connection code U

Note 3: All ABB adapters used with the Front Bonded G1 in hygienic connection have a leak detect port of 2.4 mm, which must be positioned at the lowest point for the installation.

Note 4: Pipe couplings ISO 2852, DIN 32676, BS 4825 Part 3 are according to EHEDG only in combination with Tri-Clamps seals Combifit International B.V., The Netherlands.

Note 5: Not available with sensor range R

Note 6: Pipe couplings DIN 11851 are according to EHEDG, 3-A only in combination with ASEPTO-STAR k-flex upgrade gaskets Kieselmann GmbH, Germany.

Note 7: Not available with Diaphragm material codes H,F and C

Note 8: Not available with Diaphragm material codes F,C

Note 9: 3A approved

Note 10: Hazardous area certification and CSA / FM ordinary location options are mutually exclusive

Note 11: Not applicable with process connections digits C,D,E,H,L,M,N,P,Q

Note 12: Option code SC has to be ordered if 0 to URL calibration record is required

Note 13: Available only with Output code A

Note 14: Option code CF provides an inspection certificate of calibration 0 to URL

Option code SC should be also selected if the inspection certificate is required for calibration different from 0 to URL

Note 15: Mutually exclusive with Inspection certificate code CF

Note 16: Only with Process connection code U

...Ordering Information

Additional ordering information model PGD100 Gauge Pressure Transmitters and PAD100 Absolute Pressure Transmitters
 Add one or more options code after the basic ordering information to select all required options.

| | XX | XX | XXX | XX | XX | XX | XX |
|--|----------|-----|-----|----|----|----|----|
| Display (see FOOTNOTE) | | | | | | | |
| Glass touch LCD display with 2-button keypad | D3 | | | | | | |
| Backlit glass touch LCD display with 2-button keypad | D4 | | | | | | |
| Extended performances* | | | | | | | |
| ± 0.075 % extended base accuracy | | E7 | | | | | |
| ± 0.1 % extended base accuracy | | E9 | | | | | |
| Hazardous area certifications (see relevant paragraph for complete detailed markings) | | | | | | | |
| ATEX Ex ia and Ex ta/tb | (Note 1) | HAM | | | | | |
| CSA approvals (USA and Canada) IS (Gas and Dust) | (Note 1) | HCM | | | | | |
| IECEX Ex ia and Ex ta/tb | (Note 1) | HJM | | | | | |
| Combined ATEX, CSA approvals (USA and Canada) and IECEx (Gas and Dust) | (Note 1) | HMM | | | | | |
| Approvals | | | | | | | |
| CSA ordinary location (USA and Canada) (PENDING) | (Note 1) | | GO | | | | |
| Accessories | | | | | | | |
| External grounding terminal (fitted as standard if hazardous area certification code Hxx is selected) | | | | | | AG | |
| Mounting bracket | | | | | | | |
| Universal for pipe or wall mounting / AISI 304 ss (1.4301) | (Note 2) | | | | | | BU |
| Software application | | | | | | | |
| Calibration to specified measuring span and/or tag number (and printed on plastic label) | (Note 3) | | | | | | SC |
| Alarm setting to low current of 3.6 mA | | | | | | | SA |
| Digital access diagnostics (requires backlit LCD display code D4) | | | | | | | SD |
| Local configuration (Easy Set Up) for 4..20mA Version | (Note 4) | | | | | | SE |

NOTE - Refer to hazardous atmospheres paragraph for compliance of digital display

* Total performance of PxD shall be calculated considering also the other factors stated in the S26 datasheet/ manual

| | XX | XXX | XX |
|--|----------|-----|-----|
| Inspection/compliance certificates | | | |
| Inspection certificate EN 10204–3.1 of calibration (5-point) | (Note 5) | CF | |
| Inspection Certificate UNI EN 10204 3.1 (9 points calibration) (PENDING) | (Note 6) | CN | |
| Inspection certificate EN 10204–3.1 of cleanliness stage | | CC | |
| Inspection certificate EN 10204–3.1 of helium leakage test of the sensor module | | CL | |
| Inspection certificate EN 10204–3.1 of the pressure test | | CH | |
| Certificate of compliance with the order EN 10204–2.1 of instrument design | | CD | |
| Inspection certificate EN 10204–3.1 of process wetted parts | | CM | |
| Certificate of compliance with the order EN 10204–2.1 of pressure bearing and wetted parts | | CW | |
| Labels | | | |
| Label and display visualization in imperial units (Pressure = inH2O/ psi at 68 °F; Temperature = deg. F) | | | LTU |
| Supplemental wired–on stainless steel plate (4 lines, 32 characters each) | | | LEW |
| Label and display visualization in Chinese | | | LTS |
| Manuals | | | |
| German | | | M1 |
| Italian (PENDING) | | | M2 |
| Spanish (PENDING) | | | M3 |
| French (PENDING) | | | M4 |
| English | | | M5 |
| Chinese (PENDING) | | | M6 |
| Portuguese (PENDING) | | | MA |
| Russian (PENDING) | | | MB |

Note 1: Hazardous area certification and CSA / FM ordinary location options are mutually exclusive

Note 2: Available only when coupled with S26 remote mount

Note 3: Option code SC has to be ordered if 0 to URL calibration record is required

Note 4: Available only with Output code A

Note 5: Option code CF provides an inspection certificate of calibration 0 to URL

Option code SC should be also selected if the inspection certificate is required for calibration different from 0 to URL

Note 6: Mutually exclusive with Inspection certificate code CF

Notes

Notes

Notes

ABB Measurement & Analytics

For your local ABB contact, visit:
www.abb.com/contacts

For more product information, visit:
www.abb.com/pressure

We reserve the right to make technical changes or modify the contents of this document without prior notice. With regard to purchase orders, the agreed particulars shall prevail. ABB does not accept any responsibility whatsoever for potential errors or possible lack of information in this document.

We reserve all rights in this document and in the subject matter and illustrations contained therein. Any reproduction, disclosure to third parties or utilization of its contents – in whole or in parts – is forbidden without prior written consent of ABB.