

# StreetSaver

## BPP007

### Mounting instruction



ta  
40°

IP65




IK08

C E

CB



Type Number	LEDs	Power	Voltage	Frequency	
BPP007 LED-HP/740 PSU II GR 60P	24	60W	220-240V	50/60 Hz	7.6
BPP007 LED-HP/830 PSU II GR 60P	24	60W	220-240V	50/60 Hz	7.6

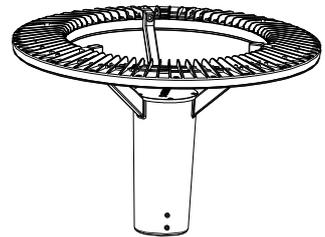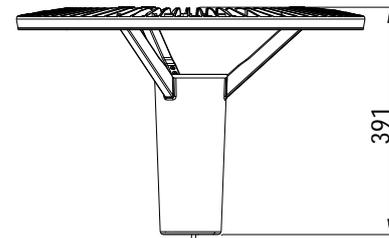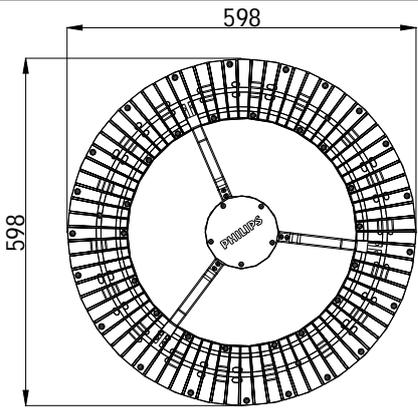

Deploy 6M length supply wire

Unit: mm

1



1. Relax tighten screw, make pole to insert lighting bottom smoothly .
2. Supply cable dia. 6~8mm. cut hole on the top of pole to make supply cable insert.




Pole height: 3~5M  
Pole Dia. 60mm

2



Tighten the screws  
2x M10/ 10 Nm

# PHILIPS

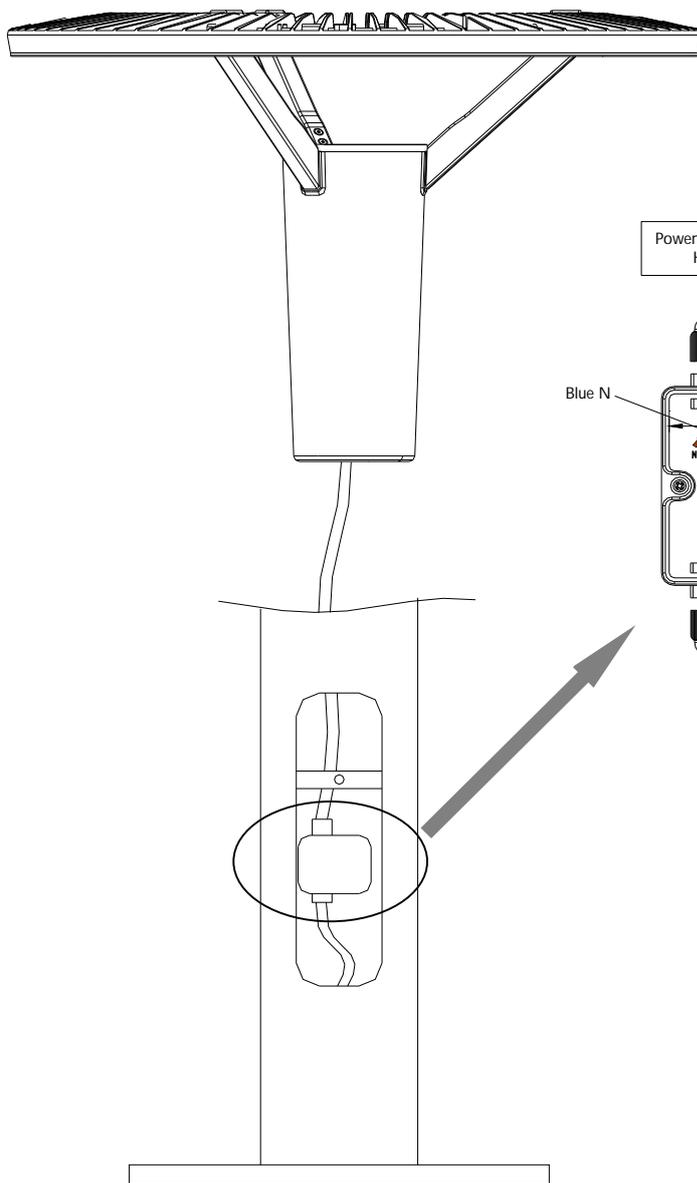

No supplied watertight box



1. The luminaires shall be installed by a qualified electrician and wired in accordance with the latest IEE electrical regulations or the national requirements.
2. No supplied watertight box, installation should be advised by qualified professional.
3. Do not switch on before complete installation.
4. The external cable of this luminaire cannot be replaced; if the cord is damaged, the luminaire shall be destroyed.
5. Lamp: non-replaceable LED.

# PHILIPS