



# Preliminary Data Sheet

## RISH MD 1340

Multifunction Meter



Measure



Control



Record



Analyze

# Preliminary Data Sheet

## RISH MD1340

**RISH MD 1340** measures important electrical parameters in 3 phase 4 wire, 3 phase 3 wire and 1 phase 2 wire Network. It displays many parameters at a glance. It measures electrical parameters like Active / Reactive / Apparent energy and all basic parameter. The instrument has two optional pulse outputs available as potential free relay or SO interface. This instrument also has 2 optional digital inputs for monitoring the external contact status, pulse counting and/or energy accumulation according to tariff.

### Applications:

- Internal Energy billing/monitoring/auditing
- Sub-metering
- Electrical load monitoring
- Genset, Test Benches and Laboratories

### Product Features:

#### True RMS Measurement

- ▶ True RMS measurement with Sampling rate of 128 samples per cycle

#### Compliance to Performance Standards

- ▶ Compliance to performance standard EN 50470-1/3, IEC 61557-12, IEC 62053-22 and 62053-23

#### Relay Output (optional)

Potential free, very fast acting relay contact configurable for following:

- ▶ **Pulse** output which can be used to drive an external counter for energy measurement.
- ▶ **Limit** (alarm) switch. Limit output also configurable for three logical combination of parameters
- ▶ **Timer** output which can be used to operate relay in cyclic manner.
- ▶ **Pre-Paid Cost** based energy tripping.
- ▶ Switch for **unhealthy three phase load**.
- ▶ **Remote Relay Control** using MODBUS.

#### Pre-Paid Cost Based Energy Tripping

- ▶ This feature provides the luxury of tripping the load whose energy has crossed the required threshold of the configured tariff amount
- ▶ The user just needs to set the energy, top-up amount and the rate per unit (kilo) of energy.

#### Health Monitoring of Three Phase Load

- ▶ This feature is applicable only for Three phase load (such as a Three phase motor) which can be monitored for phase failure, phase reversal, voltage & current unbalance, under frequency, under voltage, over voltage and over current.
- ▶ Further, set a relay on this mode and use it for indication / guard against such faults.

#### Direct remote access (Optional)

- ▶ Remote configuration of the Instrument and access of measured parameter via Modbus RS485.

#### High Max System Power Limit

- ▶ Upto 1250 MVA (L-N) system power is measurable

#### Energy as per IEC 62053

- ▶ Active Energy accuracy 0.5s as per 62053-22, Class B as per EN 50470-3 and Reactive Energy as per 62053-23
- ▶ Active Energy accuracy 0.2s (optional) as per 62053-22 and Reactive Energy as per 62053-23
- ▶ Independent Import and Export Energy counter. Active energy (kWh), Reactive energy (kVARh), Apparent energy (kVAh) measurement of system as well as phase-wise.

#### Digital Inputs

2 Digital Inputs (Optional) can be configured as:

- ▶ Status to indicate if the input is present or not.
- ▶ Pulse Counter for counting pulses from external sources.
- ▶ Tariff Input to store separate energy counters on the basis of digital inputs present.

#### Dual Tariff

- ▶ 2 Tariff based on digital input available
- ▶ 6 Energy sources configurable for tariff based energy

#### THD and Individual Harmonics Measurement:

- ▶ The instrument measures per phase THD and individual harmonic up to 31st harmonics for voltage & current.

#### User Assignable Screens

- ▶ Instrument measures more than 85 parameters and these parameters are displayed through different screens.
- ▶ User can select minimum 1 no. and maximum 10 nos. of screens out of all the screens as per application requirement.

#### Min-Max Values

- ▶ Min-Max Voltage, Current, Active/Reactive/Apparent power, Power factor, Phase angle, Frequency

#### Old Values

- ▶ Old value storage after Reset

#### Compliance to International Safety standards

- ▶ Compliance to International Safety standard IEC 61010-1- 2010.

#### EMC Compatibility

- ▶ Compliance to International standard IEC 61326



Measure



Control



Record




Analyze


# Preliminary Data Sheet

## RISH MD1340

### Dimensions Details:

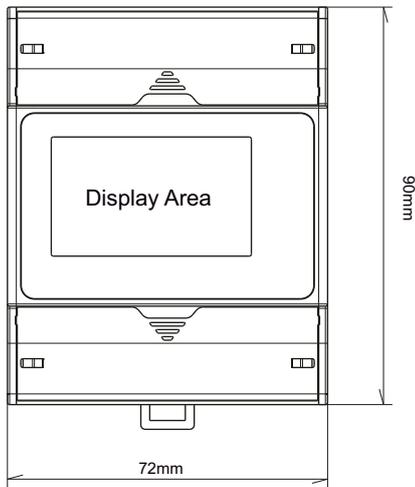

Front View

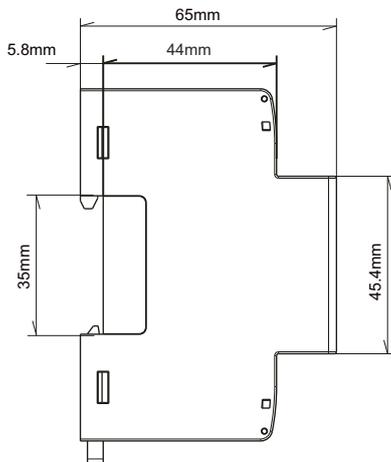

Side View

### Technical Specifications:

#### Input Voltage:

Nominal input voltage (Vn)	100VLL to 600 VLL AC RMS
Programmable on site.	57.5VLN to 346.42 VLN AC RMS
System PT primary values	100VLL to 1200kVLL programmable on site.
Measuring Range	20%....120% of nominal value
Overload Withstand	2 x rated value for 1 second, repeated 10 times at 10 second intervals
Overload Indication	"-OL-" >121% of Nominal value
Nominal input voltage burden	< 0.3VA approx. per phase(at nominal 240V)

#### Input Current:

Nominal input current(In)	1A / 5A onsite programmable
System CT primary values	From 1A to 9999A
Measuring Range	1%....200% of nominal value (1%....180% of nominal value for CF = 2)
Overload Indication	"-OL-" >205% of Nominal value
Nominal input current burden	< 0.3VA approx. per phase
Overload Withstand	20 x rated value for 1 second, repeated 5 times at 5 minute intervals

#### Auxiliary Supply:

Higher Auxiliary supply range	100-550V AC/DC (230V AC/DC nominal)
As per IEC 61557-12	100-320V AC/DC (230V AC/DC nominal)
Lower Auxiliary supply range	12-60V AC/DC (24 V AC /48 V DC nominal)
Aux Supply frequency	45 to 66 Hz range
Auxiliary Supply burden	< 6VA approx. (at nominal value)

#### Operating Measuring Ranges:

Current (Energy Measurement)	1....200% of nominal value
Starting current : as per Standard IEC62053-22(0.5s)	
as per Standard IEC62053-22(0.2s)(optional)	
Voltage	20... 120% of nominal value
Power Factor	0.5 Lag ... 1... 0.8 Lead
Frequency	40Hz to 70Hz

#### Reference Conditions for Accuracy:

Reference temperature	23°C +/- 2°C
Input Waveform	Sinusoidal(distortion factor 0.005)
Input frequency	50/60 Hz ± 2%
Auxiliary supply frequency	50/60 Hz ± 1%
Total Harmonic distortion	THD <sub>v</sub> ≤ 50% upto 31st at Vn THD <sub>i</sub> ≤ 200% upto 31st at In (THD <sub>i</sub> ≤ 180% upto 31st at In for CF = 2)
Voltage range	20%....120% of nominal value
Current range	10%....200% of nominal value

#### Display Specification:

Display	3 Line 4 Digit LCD with Backlit
Response time to step input	1 sec approx.
LED Indications	Impulse (Integration of Energy)
Display scrolling	Automatic/Manual (Programmable)
Push buttons	4 Buttons



Measure



Control



Record



Analyze

### Technical Specifications:

#### Accuracy:

Active Energy (Bidirectional)  
 EN 50470-1/3 : Standard-Class B  
 IEC 62053-22 : Standard-Class 0.5S (Optional-Class 0.2S)  
 IEC 61557-12 : Standard-Class 0.5 (Optional-Class 0.2 for 5A In (Class 0.5 for 1A In))  
 Apparent Energy Class 1 as per IEC 61557-12  
 Reactive Energy Class 2 as per IEC 62053 - 23 and IEC 61557 - 12

	Class 0.2s (on Request)	Class 0.5s (Standard)
Voltage	± 0.2% of Nominal value	± 0.5% of Nominal value
Current	± 0.2% of Nominal value	± 0.5% of Nominal value
Frequency	± 0.1% of Mid frequency	± 0.1% of Mid frequency
Active Power	± 0.2% of Nominal value	± 0.5% of Nominal value
Re-Active Power	± 1.0% of Nominal value	± 1.0% of Nominal value
Apparent Power	± 0.2% of Nominal value	± 0.5% of Nominal value
Power Factor/ angle	±3°	±3°
THD (V/I) w.r.t. fundamental	±5% (upto 31st Harmonics)	±5% (upto 31st Harmonics)
Individual Harmonics	±5% (upto 31st Harmonics)	±5% (upto 31st Harmonics)

#### Applicable Standards:

Electromagnetic Compatibility	IEC 61326 - 1, Table 2
Immunity	IEC 61000-4-2, -3, -4, -5, -6, -8, -11
Emission	CISPR 11
Safety	IEC 61010-1-2010
IP for water & dust	IEC60529
Pollution degree	2
Installation category	III

#### Isolation:

Protective Class	2
High voltage test	
Input+Aux Vs Surface	4kV RMS, 50Hz for 1min
Input / Aux Vs Others	3.3kV RMS, 50Hz for 1min
DI/Pulse Out/RS485 Vs Others	3.3kV RMS, 50Hz for 1min
DI Vs DI / Pulse Out Vs Pulse Out	2.2kV RMS, 50Hz for 1min
Impulse Voltage Withstand	6kV for 1.2 / 50 uSec

#### Environmental:




Operating temperature	-20 to +70°C
Storage temperature	-40 to +85°C
Relative humidity	0... 95%RH (non condensing)
Warm up time	Minimum 3 minute
Shock (As per IEC60068-2-27)	Half sine wave, Peak acceleration 30gn (300 m/s <sup>2</sup> ), duration 18ms.
Vibration	10... 150...10 Hz, 0.15mm amplitude
Number of Sweep cycles	10 per axis
Enclosure	IP 20 (Terminal side) and IP54(Front side)

#### Interfaces:

Impulse Led	For Energy testing
Digital Input(Optional)	20... 300 VAC / 10... 60 VDC Optical couplers, Min pulse width 10ms Min length between 2 pulses 18ms
Relay(Optional)	250 VAC, 5 A AC / 30VDC, 5A DC
S0(Optional)	Opto-coupler max. 30V, 20mA, at least 5V Pulse width 30ms, Impedance 100 ohm
Modbus (Optional)	RS485, max. 1200m Baud rate : 4.8k, 9.6k, 19.2k, 38.4k, 57.6kpbs.

### Electrical Connection:

#### Network Types :

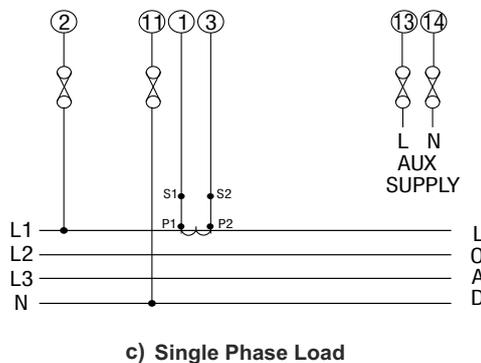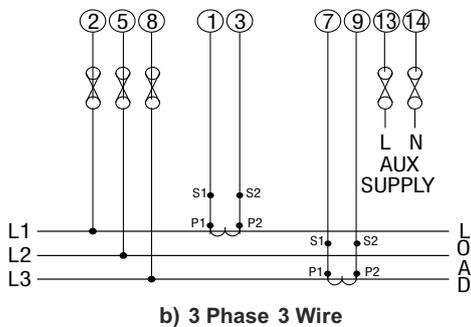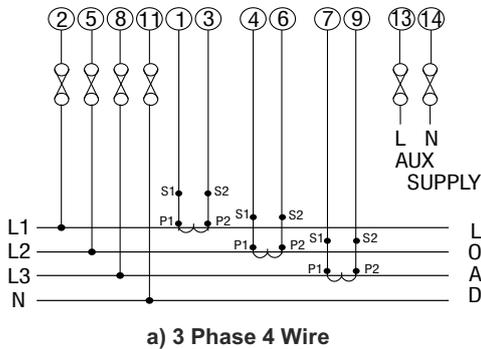

It is recommended that the wires used for connections to the instrument should have lugs soldered at the end. That is, the connections should be made with Lugged wires for secure connections.



Measure



Control



Record



Analyze

### Measured Parameter System wise:

✓ : Available

\* : Not Available

Sr No	Parameters	3 Phase 4Wire	3Phase 3Wire	1Phase 2Wire
1.	System Import Active Energy <sup>1</sup>	✓	✓	✓
2.	L1,L2,L3 Import Active Energy <sup>1</sup>	✓	*	*
3.	System Export Active Energy <sup>1</sup>	✓	✓	✓
4.	L1,L2,L3 Export Active Energy <sup>1</sup>	✓	*	*
5.	System Total Active Energy <sup>1</sup>	✓	✓	✓
6.	L1,L2,L3 Total Active Energy <sup>1</sup>	✓	*	*
7.	System Inductive Reactive Energy <sup>1</sup>	✓	✓	✓
8.	L1,L2,L3 Inductive Reactive Energy <sup>1</sup>	✓	*	*
9.	System Capacitive Reactive Energy <sup>1</sup>	✓	✓	✓
10.	L1,L2,L3 Capacitive Reactive Energy <sup>1</sup>	✓	*	*
11.	System Total Reactive Energy <sup>1</sup>	✓	✓	✓
12.	L1,L2,L3 Total Reactive Energy <sup>1</sup>	✓	*	*
13.	System Apparent Energy <sup>1</sup>	✓	✓	✓
14.	L1,L2,L3 Apparent Energy <sup>1</sup>	✓	*	*
15.	System Active Power (kW)	✓	✓	✓
16.	L1,L2,L3 Active Power (kW)	✓	*	*
17.	System Total Re-active Power (kVAr)	✓	✓	✓
18.	L1,L2,L3 Total Re-active Power (kVAr)	✓	*	*
19.	System Fundamental Re-active Power (kVAr) <sup>2</sup>	✓	✓	✓
20.	L1,L2,L3 Fundamental Re-active Power (kVAr) <sup>2</sup>	✓	*	*
21.	System Distorted Re-active Power (kVAr) <sup>2</sup>	✓	✓	✓
22.	L1,L2,L3 Distorted Re-active Power (kVAr) <sup>2</sup>	✓	*	*
23.	System Apparent Power (kVA)	✓	✓	✓
24.	L1,L2,L3 Apparent Power (kVA)	✓	*	*
25.	System Power Factor	✓	✓	✓
26.	L1,L2,L3 Power Factor	✓	*	*
27.	System Displacement Power Factor <sup>2</sup>	✓	✓	✓
28.	L1,L2,L3 Displacement Power Factor <sup>2</sup>	✓	*	*
29.	System Reactive Power Factor <sup>2</sup>	✓	✓	✓
30.	L1,L2,L3 Reactive Power Factor <sup>2</sup>	✓	*	*
31.	System LF Factor SgnQ(1-(P/S)) <sup>2</sup>	✓	✓	✓
32.	L1,L2,L3 LF Factor SgnQ(1-(P/S)) <sup>2</sup>	✓	*	*
33.	System Phase Angle	✓	✓	✓
34.	L1,L2,L3 Phase Angle L1	✓	*	*
35.	Current Demand	✓	✓	✓
36.	kVA Demand	✓	✓	✓
37.	Import kW Demand	✓	✓	✓
38.	Export kW Demand	✓	✓	✓
39.	Inductive Var Demand	✓	✓	✓
40.	Capacitive Var Demand	✓	✓	✓
41.	Max Current Demand	✓	✓	✓
42.	Max kVA Demand	✓	✓	✓
43.	Max Import kW Demand	✓	✓	✓
44.	Max Export kW Demand	✓	✓	✓
45.	Max Inductive Var Demand	✓	✓	✓
46.	Max Capacitive Var Demand	✓	✓	✓
47.	Run Hour	✓	✓	✓
48.	On Hour	✓	✓	✓
49.	Number of Interruptions	✓	✓	✓
50.	System Voltage	✓	✓	✓
51.	L1,L2,L3 Voltage	✓	*	*
52.	L12,L23,L31 Voltage	✓	✓	*



Measure



Control



Record



Analyze

# Preliminary Data Sheet

## RISH MD1340

### Measured Parameter System wise:

✓ : Available

× : Not Available

Sr No	Parameters	3 Phase 4Wire	3Phase 3Wire	1Phase 2Wire
53.	System Voltage THD	✓	✓	✓
54.	L1-L2-L3 Voltage THD	✓	✓	×
55.	System Current	✓	✓	✓
56.	L1-L2-L3 Current	✓	✓	×
57.	System Current THD	✓	✓	✓
58.	L1-L2-L3 Current THD	✓	✓	×
59.	Individual Harmonics VL1(Up to 31st Harmonics)	✓	✓	✓
60.	Individual Harmonics VL2 (Up to 31st Harmonics)	✓	✓	×
61.	Individual Harmonics VL3 (Up to 31st Harmonics )	✓	✓	×
62.	Individual Harmonics IL1(Up to 31st Harmonics )	✓	✓	✓
63.	Individual Harmonics IL2(Up to 31st Harmonic )	✓	×	×
64.	Individual Harmonics IL3(Up to 31st Harmonics )	✓	✓	×
65.	Neutral Current (Calculated)	✓	×	×
66.	Frequency	✓	✓	✓
67.	RPM	✓	✓	✓
68.	Phase Sequence Indication	✓	✓	×
69.	Current Reversal Indication	✓	×	✓
70.	Phase (V-I) Absent Indication	✓	×	×
71.	Tariff Source 1 Energy Count	✓	✓	✓
72.	Tariff Source 2 Energy Count	✓	✓	✓
73.	Tariff Source 3 Energy Count	✓	✓	✓
74.	Tariff Source 4 Energy Count	✓	✓	✓
75.	Tariff Source 5 Energy Count	✓	✓	✓
76.	Tariff Source 6 Energy Count	✓	✓	✓
77.	Old Max A Demand <sup>2</sup>	✓	✓	✓
78.	Old Max VA Demand <sup>2</sup>	✓	✓	✓
79.	Old Max kW Import Demand <sup>2</sup>	✓	✓	✓
80.	Old Max kW Export Demand <sup>2</sup>	✓	✓	✓
81.	Old Max Var Inductive Demand <sup>2</sup>	✓	✓	✓
82.	Old Max Var Capacitive Demand <sup>2</sup>	✓	✓	✓
83.	Old System Import Active Energy <sup>2</sup>	✓	✓	✓
84.	Old L1-L2-L3 Import Active Energy <sup>2</sup>	✓	×	×
85.	Old System Export Active Energy <sup>2</sup>	✓	✓	✓
86.	Old L1-L2-L3 Export Active Energy <sup>2</sup>	✓	×	×
87.	Old System Inductive Reactive Energy <sup>2</sup>	✓	✓	✓
88.	Old L1-L2-L3 Inductive Reactive Energy <sup>2</sup>	✓	×	×
89.	Old System Capacitive Reactive Energy <sup>2</sup>	✓	✓	✓
90.	Old L1-L2-L3 Capacitive Reactive Energy <sup>2</sup>	✓	×	×
91.	Old System Apparent Energy <sup>2</sup>	✓	✓	✓
92.	Old L1-L2-L3 Apparent Energy <sup>2</sup>	✓	×	×
93.	Old Run Hour <sup>2</sup>	✓	✓	✓
94.	Old On Hour <sup>2</sup>	✓	✓	✓
95.	Old Number of Interruptions <sup>2</sup>	✓	✓	✓

Note: 1. Energy on display is autoranging & unit for Energy parameters on modbus are dependent on CT PT ratio or unit selected by user.  
2. Parameters are available only on modbus.



Measure



Control



Record



Analyze

### Order Code:

Ordering Information:

Product Code : MD00 - 3 - 3 - 01 - 02 - X - H - X - 0000

**M** : RS485

**S** : RS485 - 1 DI - 1 S0 Output

**C** : RS485 - 2 DI - 2 Relay Output

**2**: Accuracy class 0.2s

**5**: Accuracy class 0.5s

### Order Code Example:

#### MD00-330102CH20000

MD 1340 3Phase input with input voltage 100-600VLL with 1A/5A internal CT, with MODBUS (RS485),with 2 relay output,2 DI with auxiliary voltage 100 to 550 V AC DC , with accuracy class 0.2s.



Measure




Control



Record



Analyze

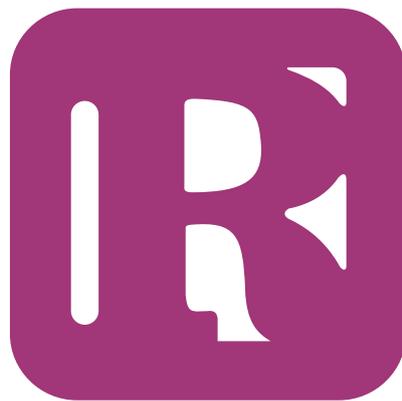

RISHABH



Measure



Control



Record



Analyze

**RISHABH INSTRUMENTS PVT. LTD.**

Trishala Unit, C-6, NICE Area, MIDC, Satpur, Nashik - 422007, India.

Tel: +91 253 2202371 / 028 | Fax: +91 253 2351064 | E-mail: [marketing@rishabh.co.in](mailto:marketing@rishabh.co.in) | [www.rishabh.co.in](http://www.rishabh.co.in)